

Calculating Energy Savings in High Performance Residential Buildings Programs

Preprint

R. Hendron, S. Farrar-Nagy, R. Anderson, and
R. Judkoff

National Renewable Energy Laboratory

P. Reeves

Partnership for Resource Conservation

E. Hancock

Mountain Energy Partnership

*To be presented at the International Energy Program
Evaluation Conference
Seattle, Washington
August 20–22, 2003*



NREL

National Renewable Energy Laboratory

1617 Cole Boulevard
Golden, Colorado 80401-3393

NREL is a U.S. Department of Energy Laboratory
Operated by Midwest Research Institute • Battelle • Bechtel

Contract No. DE-AC36-99-GO10337

NOTICE

The submitted manuscript has been offered by an employee of the Midwest Research Institute (MRI), a contractor of the US Government under Contract No. DE-AC36-99GO10337. Accordingly, the US Government and MRI retain a nonexclusive royalty-free license to publish or reproduce the published form of this contribution, or allow others to do so, for US Government purposes.

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available electronically at <http://www.osti.gov/bridge>

Available for a processing fee to U.S. Department of Energy
and its contractors, in paper, from:

U.S. Department of Energy
Office of Scientific and Technical Information
P.O. Box 62
Oak Ridge, TN 37831-0062
phone: 865.576.8401
fax: 865.576.5728
email: reports@adonis.osti.gov

Available for sale to the public, in paper, from:

U.S. Department of Commerce
National Technical Information Service
5285 Port Royal Road
Springfield, VA 22161
phone: 800.553.6847
fax: 703.605.6900
email: orders@ntis.fedworld.gov
online ordering: <http://www.ntis.gov/ordering.htm>



CALCULATING ENERGY SAVINGS IN HIGH PERFORMANCE RESIDENTIAL BUILDINGS PROGRAMS

*Robert Hendron, Sara Farrar-Nagy, Ren Anderson, Ron Judkoff
National Renewable Energy Laboratory, Golden, Colorado*

Paul Reeves

Partnership for Resource Conservation, Boulder, Colorado

Ed Hancock

Mountain Energy Partnership, Boulder, Colorado

Abstract

Accurate and meaningful energy savings calculations are essential for the evaluation of residential energy efficiency programs sponsored by the U.S. Department of Energy (DOE), such as the Building America Program (a public-private partnership designed to achieve significant energy savings in the residential building sector). The authors investigated the feasibility of applying existing performance analysis methodologies such as the Home Energy Rating System (HERS) and the International Energy Conservation Code (IECC) to the high performance houses constructed under Building America, which sometimes achieve whole-house energy savings in the 50-70% range. However, because Building America addresses all major end-use loads and because the technologies applied to Building America houses often exceed what is envisioned by energy codes and home-rating programs, the methodologies used in HERS and IECC have limited suitability, and a different approach was needed. The authors have researched these issues extensively over the past several years and developed a set of guidelines that draws upon work done by DOE's Energy Information Administration, the California Energy Commission, the International Code Council, the Residential Energy Services Network (RESNET), and other organizations that have developed similar methodologies to meet their needs. However, the final guidelines are tailored to provide accurate techniques for quantifying energy savings achieved by Building America to help policymakers assess the effectiveness of the program.

Introduction and Background

The Building America program is an industry-driven research program sponsored by the U.S. Department of Energy (DOE) that applies systems engineering approaches to accelerate the development and adoption of advanced building energy technologies in new residential buildings. This program supports five building industry teams in the production of advanced residential buildings on a community scale. These teams use a systems engineering process to perform cost and performance assessments relative to each builder's standard practice, with the overall goal of reducing energy use without increasing the construction cost. The energy efficiency concepts incorporated in these houses are evaluated by conducting successive design, test, redesign, and retest iterations until cost and performance trade-offs yield innovations that can be cost-effectively used in production-scale housing.

The goals of the Building America program are as follows: (1) accelerate the use of advanced building energy systems in new residential construction through development and application of systems engineering approaches among cross-cutting industry teams; (2) develop innovative technologies and strategies that allow the U.S. housing industry to deliver environmentally sensitive, quality housing on a community scale while maintaining profitability and competitiveness of homebuilders and product

suppliers; and (3) reduce energy consumption by 40-60% for all end-uses in new houses built under the program, reduce construction site waste, increase the use of recycled materials, increase labor productivity, and reduce construction-cycle time.

To measure progress toward these goals, cost and performance trade-offs are evaluated through a series of controlled field and laboratory experiments supported by energy analysis techniques that use test data to “calibrate” energy simulation models. This paper summarizes these energy analysis procedures, which the authors feel have substantial relevance for the evaluation of homes in programs similar to Building America.

Purpose

As Building America has grown to include a large and diverse cross-section of the home building industry, accurate and consistent analysis techniques have become more important to help program partners perform design trade-offs and calculate energy savings for prototype houses built as part of the program. Many useful approaches and tools are available to calculate energy savings, and this document illustrates some of the analysis concepts proven effective and reliable for analyzing the transient energy usage of advanced energy systems as well as entire houses.

The analysis procedure described in this document provides a starting point for (1) a standard approach for calculating the energy savings of a prototype house relative to two important base cases (Builder Standard Practice and Regional Standard Practice) and (2) using building simulation to calculate annual energy savings based on side-by-side short-term field testing of a prototype house and base-case house(s). By establishing a standard analysis approach with well-defined set of reference houses and operating conditions, energy savings can be calculated in a consistent and meaningful way. Builders are thereby able to make informed judgments about optimal energy efficiency packages, and program managers can confidently track progress toward the achievement of important performance goals.

The first section of this paper provides general recommendations for prototype and base-case design assumptions, operating conditions, and analysis tools. Many other valid techniques and definitions have been developed by other organizations and may be very useful to builders for specialized applications. For example, the Home Energy Rating System (HERS) rating procedure must be followed to obtain an ENERGY STARTM certification.¹ Also, it may be necessary to determine whether or not a prototype meets the International Energy Conservation Code (IECC) or Model Energy Code (MEC), which may apply if adopted by the state or local government. Both HERS and IECC have developed their own base case definitions and standard operating conditions suited for the particular needs of their program constituents, but unfortunately these base cases were deemed inadequate for the performance levels targeted by Building America.¹

The second section presents guidelines for the effective hourly analysis and reporting of energy savings in residential buildings. Although many of the suggestions were developed with Building America in mind, these guidelines are general enough to provide very useful techniques for comparing the energy performance of two similar houses in many other situations.

¹ Additional information about these reference cases can be found at the U.S. Department of Energy Codes and Standards Web site (http://www.eren.doe.gov/buildings/codes_standards/buildings/) or the National Association of State Energy Officials Web site (<http://www.natresnet.org/techguide/>).

Performance Analysis Guidelines

Analysis Tools

A key issue in any building energy analysis is the choice of the tool or program used to estimate energy consumption. An hourly simulation is often necessary to fully evaluate the time-dependent energy impacts of advanced systems used in Building America houses. Thermal mass, solar heat gain, and wind-induced air infiltration are examples of time-dependent effects that can only be accurately analyzed using a model that calculates heat transfer and temperature in short time intervals. In addition, an hourly simulation program is necessary to accurately estimate peak energy loads. Because of the large number of users, public availability, and level of technical support, DOE-2 is the hourly simulation tool recommended for systems analysis studies performed under the Building America program. Teams are also encouraged to use other simulation tools when appropriate for specialized building simulation analysis, provided the tool has met the requirements of HERS BESTEST (Judkoff and Neymark, 1995) in accordance with the software certification sections of the RESNET/HERS Guidelines (NASEO, 1999). Regardless of the tool selected, analysts should report a comprehensive set of results, including annual heating and cooling energy (both source and site), peak hourly energy consumption, and cost-benefit calculations if available. A full summary of building energy simulation tools can be found at the DOE building energy tools web site (www.eren.doe.gov/buildings/energy_tools/).

Prototype and Base-Case Definitions

Throughout the remainder of this document, the term “prototype” refers to a reengineered house with advanced systems and design features built for the first time as part of the Building America program. In the model, all parameters for the prototype house are based on measured data or final design specifications, with a few exceptions as defined in Hendron et al (2001). The term “base case” refers to one of the following two designs (See also Figure 1):

- ***Regional standard practice.*** This base case represents the house design that is most commonly built in the same geographic region as the prototype house. Energy savings relative to regional standard practice is an important measure of how a Building America prototype compares to similar houses currently being built in a particular market. The key elements of the regional standard practice are summarized in Figure 2.
- ***Builder standard practice.*** This base case describes the house design that would have been built without the participation of the builder in the Building America program. It may be either an existing model in the builder’s inventory, or a house similar to the prototype, but with design features and construction techniques consistent with the builder’s current inventory. A side-by-side test combined with a calibrated hourly simulation provides the best comparison of a prototype with builder standard practice, but this situation is often not practical. Energy savings relative to builder standard practice provides a measure of the direct influence of Building America for a particular house. The specifications for the builder standard practice design are fairly straightforward to determine, but detailed guidelines are provided in Hendron et al (2001).



Figure 1. The prototype is evaluated relative to two base cases

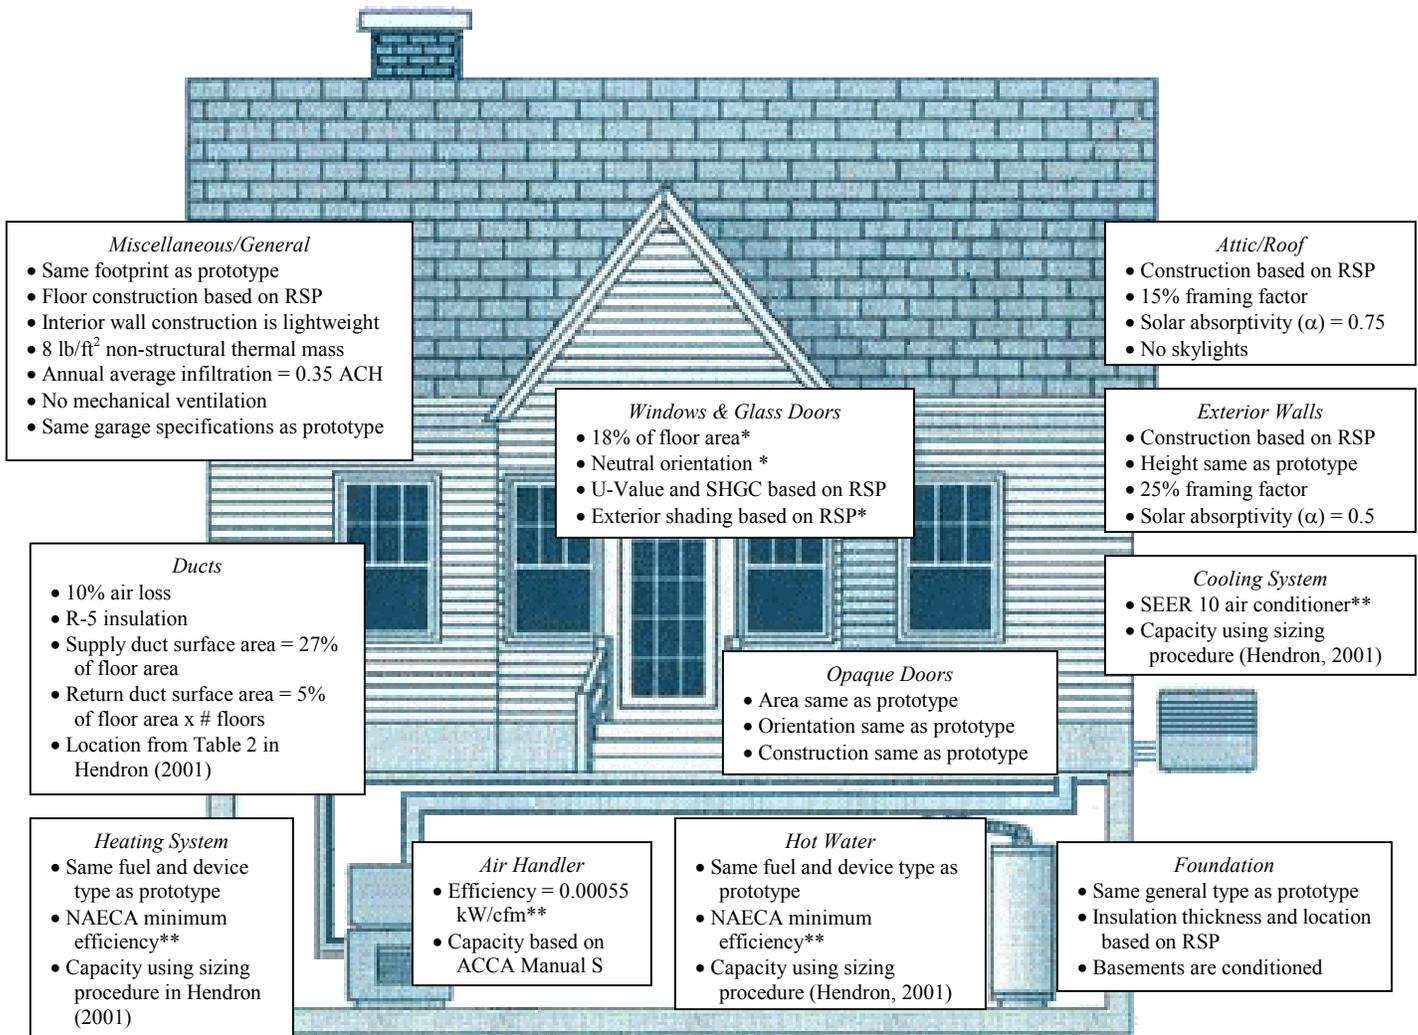


Figure 2. Regional standard practice (RSP) specifications

* Applies if the prototype house uses specific window or shading modifications to reduce heating or cooling loads as part of a broader bioclimatic strategy. Otherwise the same window area (up to 18%), orientation, and shading as the prototype are used. Neutral orientation means that energy use is calculated as the average of each house orientation using the same proportion of glazing in each orientation as the prototype.

** Part-load performance of space conditioning systems (air conditioners, heat pumps, furnaces, and air distribution) calculated using the methodologies described in the California Energy Commission Nonresidential ACM Approval Manual (CEC, 2001).

Operating Conditions

The following operating conditions and other assumptions shall apply to both the prototype house and the two base cases defined in this document. These operating conditions are based on the cumulative experience of the authors through their work on Building America and other residential energy efficiency programs. Note that these operating conditions assume that the analyst is evaluating a new house or an existing house where the actual occupant behavior is unknown. In the case of an occupied house where the homeowner is considering energy improvements or a new house where the

homebuyer has known behavior, it is more appropriate to use the expected operating conditions for the actual occupants.

1. Thermostat set point for cooling: 78°F
Thermostat set point for heating: 68°F
2. Schedules for opening and closing windows and shades vary greatly with climate, house orientation, and occupant behavior. For the purpose of modeling the prototype and base-case houses, draperies are assumed to be drawn over half of the windows all of the time. The drawn curtains are assumed to decrease the solar gain by 40% and add approximately an R -0.5 to the fenestration. Screens are assumed to be present on half of the windows as well, and the combined dirt and screen is assumed to decrease solar gains by 10%. The natural ventilation temperature schedule is set to a constant 68°F, forcing the windows closed if the indoor temperature falls below this value. In situations where there is a cooling load, the outdoor temperature is below the indoor temperature, and the window is not already open, the probability of the window being opened is set at a constant 50%.
3. Total internal sensible heat gain from lights, people, and equipment varies with the size of the prototype house. Typical equipment intensity is calculated using Equation 1:

Equation 1: **Equipment load (Btu/day/ft²) = [House area (ft²) x 12.5 (Btu/day/ft²) + 15,000 (Btu/day)] / House area (ft²)**

Smaller loads may be used for lighting in the prototype house if the light fixtures contain ballasts that only function with energy efficient bulbs, or for home appliances (e.g., dishwashers and refrigerators) if the appliances are included as standard equipment by the builder. Because the equipment heat gains may vary by space (i.e., bedrooms and nonbedrooms) and time of day, separate schedules should be created that reflect realistic occupancy patterns. However, the total daily heat gain due to this component should still equal the calculated equipment load. Sensible heat gain from each person is 210 Btu/hr and latent heat gain is 140 Btu/hr. The total number of people living in a typical house is assumed to be equal to the number of bedrooms plus one. An appropriate occupancy schedule should be developed to calculate total heat gains from people on an hourly basis.

4. Estimated hot-water usage based on Equation 2.

Equation 2: Gallons/day = 30 gallons + (10 gallons x number of bedrooms)

5. Weather data is based on typical meteorological year (TMY2) data from 1961 to 1990¹ or equivalent data for the location most similar in climate.

Comparing a Prototype House to a Base Case

The process of evaluating Building America house performance involves the comparison of energy use between a base case and a Building America design. Energy savings are typically calculated by comparing the total annual heating and cooling energy for each house, but the procedures described in this paper can easily be extended to all end-uses. Only energy derived from fossil fuel, nuclear, or hydropower sources is considered; contributions from site-generated renewable energy are excluded from the calculation of total energy consumption.

To calculate energy usage for a prototype house and either the regional standard practice or builder standard practice base case, the following equation is used. Energy usage for the prototype

¹ Downloadable from the NREL web site (http://redc.nrel.gov/solar/old_data/nsrdb/tmy2/)

should always be calculated in each of the four cardinal orientations, plus any other orientations that may be expected as part of the community layout. Energy units shall be in Btu and source energy is the basis for comparison. For propane and fuel oil, it is assumed that the source energy multipliers are equal to unity (CEC, 1999).

Equations 3 & 4:

$$\begin{aligned} \text{Total annual heating/} &= \text{Annual electric heating and cooling energy (kWh)} \bullet 3412 \bullet M_e \\ \text{cooling energy usage (Btu)} &+ \text{Annual gas heating and cooling energy (therms)} \bullet 100,000 \bullet M_g \\ &+ \text{Annual propane heating and cooling energy (gallons)} \bullet 91,080 \\ &+ \text{Annual fuel oil heating and cooling energy (gallons)} \bullet 138,400 \end{aligned}$$

$$\begin{aligned} \text{Total annual home} &= \text{Annual electric energy for all applications (kWh)} \bullet 3412 \bullet M_e \\ \text{energy usage (Btu)} &+ \text{Annual gas energy for all applications (therms)} \bullet 100,000 \bullet M_g \\ &+ \text{Annual propane energy for all applications (gallons)} \bullet 91,080 \\ &+ \text{Annual fuel oil energy for all applications (gallons)} \bullet 138,400 \end{aligned}$$

Where: $M_e = 3.57 =$ Site to source multiplier for electricity (EIA, 1995).
 $M_g = 1.02 =$ Site to source multiplier for natural gas (EIA, 1995).

To calculate percent energy savings for a prototype house compared to either the regional standard practice or builder standard practice base case, Equation 5 is used. In the case of a prototype that uses a bioclimatic design strategy, the energy usage of the base case will be the average of the energy usage in each of the four cardinal orientations.

Equation 5:

$$\% \text{ Annual energy savings} = (\text{Annual source energy usage for base case} - \text{Annual source energy usage for prototype}) / \text{Annual source energy usage for base case}$$

Peak hourly energy consumption is calculated in a similar manner and is based on the hour with the greatest gas or electric energy consumption during the course of one year as determined by the hourly simulation

Differences Among Base Case Definitions

Because each of the base cases has a unique purpose in the analysis of Building America prototype houses, there are important differences in how elements of each base case are defined. Table 1 illustrates some of these differences between the two base-case definitions described in this paper, along with the HERS Reference Home and the IECC Standard Design. Note that several measures seen in high performance homes are not credited or only partially credited relative to the HERS or IECC base cases, but are credited using the approach described in this document. Examples include important energy saving measures such as duct performance improvements (adding duct insulation, reducing duct leakage, moving the ducts into conditioned space), sealing and insulating normally vented spaces such as crawl spaces and attics, bioclimatic design measures (enhanced shading, thermal mass, cool roofs), efficient lighting and appliances, advanced framing, site generated electricity, HVAC downsizing, and fuel switching (Builder Standard Practice only).

Conversely, certain measures credited by HERS or IECC were deemed inappropriate for Building America because of unproven effectiveness (air tightness below 0.35 ACH, programmable thermostats, exterior door improvements). For example, a house with air infiltration of 0.1 ACH (well below that recommended by ASHRAE) and no ventilation will likely result in occupants opening windows more often, negating any positive effects of the additional air tightness. In addition to the differences listed below, there are a number of specific differences in the values used for various design features of the base cases and the

detail in which these features are defined (Hendron et al., 2001). These values were chosen because the authors felt they were more representative of actual current standard practice in the building industry.

It is very difficult to make definitive statements regarding which base case is the most energy efficient. However, we do know that the HERS Reference Home was based on the 1995 Model Energy Code, a somewhat less stringent predecessor to IECC, especially in southern climates where low solar heat gain windows were not required until IECC was adopted. Also, Regional Standard Practice will generally exceed the requirements of the IECC in those jurisdictions where the code has been adopted. Builder Standard Practice could be more or less efficient than Regional Standard Practice, but most Building America partners are lead builders in their market and typically build homes more energy efficient than their competitors. As an example, Builder Standard Practice for one Building America partner in Tucson was calculated to be approximately 24% more efficient than the HERS Reference Home and 14% more efficient than Regional Standard Practice.

Table 1. Credit for Energy Savings from Various Design Measures Using Common Base Cases

<i>Design change</i>	<i>Regional Standard Practice</i>	<i>Builder Standard Practice</i>	<i>HERS Reference Home</i>	<i>IECC Standard Design</i>
Move ducts into conditioned space	Yes	Yes	Yes	No
Reduced energy loss of ducts	Yes	Yes	No ^(a)	No ^(a)
Reduce air infiltration below 0.35 ACH	No	No	Yes	Yes
Fuel switching	No	Yes	No	No
Combo water/space heater	No	Yes	Yes	Yes
No skylights	Yes	Yes	No	Yes
Unvented attic or crawl space	Yes	Yes	No	No
Exterior shading	Yes	Yes	Yes	No
Added thermal mass in walls	Yes	Yes	Yes	No
Reduced wall/attic framing factor	Yes	Yes	Yes	No
Cool roofs/walls	Yes	Yes	Yes	No
Door area and U-value	No	No	Yes	Yes
Site-generated electricity	Yes	Yes	No	No ^(b)
Programmable thermostat	No	No	Yes	Yes
Downsize HVAC capacity below Manual J	Yes	Yes	No	No
Energy efficient lights and appliances	Yes	Yes	No	No

(a) Except when leakage is reduced below 5%.

(b) Except for photovoltaics with battery storage.

Residential Energy Modeling Approach

This section offers a set of guidelines for creating the simulation models needed for the analysis of Building America prototype house designs, sets forth a clear methodology for conducting the analysis, and presents a format for reporting the results. These guidelines and the examples presented are based on the National Renewable Energy Laboratory’s (NREL) analysis of past and current Building America projects. The modeling efforts associated with Building America are intended to quantify the energy savings of a wide variety of efficiency measures. For this reason, Building America energy simulations, as compared to many other residential energy simulations, require a relatively high level of detail in the building shell, building operation, and equipment performance. While the framework for

the analysis is presented here, it is the responsibility of each analyst to use this framework in the most appropriate way for each project.

Analysis Approach

The analysis approach covered in this paper assumes the use of DOE-2. Other simulation tools may be used with minor modifications, depending on the specific inputs allowed by that tool. The typical heating and cooling annual energy use of a new building design is compared to a base-case building of the same basic description, only without the improved features. Energy for domestic hot water, lighting, and appliances may also be included if efficiency measures are applied for these end-uses. Site energy use, energy costs, and source energy use are all used to compare the buildings.

Modeling Process

The process of creating a series of energy simulation models using DOE-2 can take many paths. For some projects, detailed hourly data from short-term testing may be available; for other projects, little more than schematic design data will be available. The major steps in the modeling process are identified below and described in detail in Hendron et al., (2001).

1. **Thermal zoning.** Identify the separate thermal zones for the model based on the floor plan and HVAC design of the Building America prototype building.
2. **Floor plan take-off.** Use the prototype floor plans to create the basic layout of the building, using DOE-2.2's polygon features.
3. **Building shell take-off.** Use the prototype construction documents to quantify individual window areas, door areas, wall areas, roof areas, etc.
4. **Building constructions.** Use the prototype construction documents to create constructions for windows, doors, walls, roof, and underground surfaces.
5. **Shading surface take-off.** Use construction documents and site information to identify building and site shading.
6. **Energy efficiency measure design.** Create DOE-2 macros for each variable of each component that will change from the base case to the prototype case.
7. **Base-case definition.** Use this document, as well as knowledge of local building practice, to define the base-case characteristics.
8. **Base case to prototype.** Translate the design improvements to DOE-2 BDL code in the simulation model to incrementally change the base-case model to the prototype design.
9. **DOE-2 simulation and design verification.** Use the DOE-2 simulation results to verify both the simulation model and building design.
10. **Energy efficiency measure analysis and reporting results.** Use the results of all the DOE-2 simulations to analyze each of the building improvements.

From Regional Standard Practice to Prototype

Once the regional standard practice house is modeled, the prototype house is created by changing the characteristics of each component that differs between the base case and prototype. In the interest of quality control and of assessing each measure's value, the incremental changes are added progressively and one at a time. Each component improvement is analyzed by simulating the new combination of measures and comparing the energy performance to the previous combination of measures.

The order and grouping of the measures is left up to the analyst. However, proper consideration should be given to a measure's benefit-to-cost (B/C) ratio. Measures with the highest B/C ratio should

be added to the base case first. Measures for which savings are highly sensitive to the order in which they are added to the base case should be identified and explored further.

As an example of measures that can be highly sensitive to the order in which they are added to the base building, consider an unvented attic measure and a duct improvement measure that were used for a Building America prototype in Tucson. The duct improvement measure lowers the air-loss rate to the attic from 15% to 3%, and the unvented attic strategy moves the insulation from the attic floor to the attic roof. If the unvented attic measure is added first, the results in Table 2 are obtained.

Table 2. Scenario 1: Unvented Attic Analyzed First

Measure Description	Htg/Clg (kWh)	Heating (therms)	Htg/Clg Cost (\$/yr)	Measure Value (\$/yr)	Package Savings (\$/yr)	Cost Savings	Source Energy	
							kBtu	Savings
Base case	3000	600	600	N/A	N/A	N/A	9715	N/A
Unvented attic	2500	590	554	46.0	46	8%	8202	16%
Duct improvement	2438	575	540	13.7	60	10%	7999	18%

Under Scenario 1, the unvented attic measure has a savings of \$46 per year, much higher than the duct improvement savings of less than \$14 per year. The B/C ratio is higher for the unvented attic measure and should come first, according to this analysis. But when the measure order is reversed, the results in Table 3 are obtained.

Table 3. Scenario 2: Duct Improvement Analyzed First

Measure Description	Htg/Clg (kWh)	Heating (therms)	Htg/Clg Cost (\$/yr)	Measure Value (\$/yr)	Package Savings (\$/yr)	Cost Savings	Source Energy	
							kBtu	Savings
Base case	3000	600	600	N/A	N/A	N/A	9715	N/A
Duct improvement	2666	533	533	66.8	67	11%	8633	11%
Unvented attic	2438	575	540	-7.1	60	10%	7999	18%

These results indicate that when measures are highly interactive, it is important to explore the sensitivity of the savings to the order of the measures. Results should be presented in multiple sequences to illustrate this sensitivity and clarify the B/C analysis.

Another important issue to consider when analyzing a high performance home is orientation. Annual heating and cooling loads, and even the relative benefits of energy efficiency measures, can vary significantly when different orientations are considered. An illustration of this effect is shown in Figure 3, based on an analysis of a Building America prototype in Pensacola, Florida. Most windows in the house are on the back wall, facing toward the east, and no passive solar design features are present in the prototype. Orientation is an important consideration when evaluating energy efficiency improvements, and is certainly essential if passive or active solar energy is used.

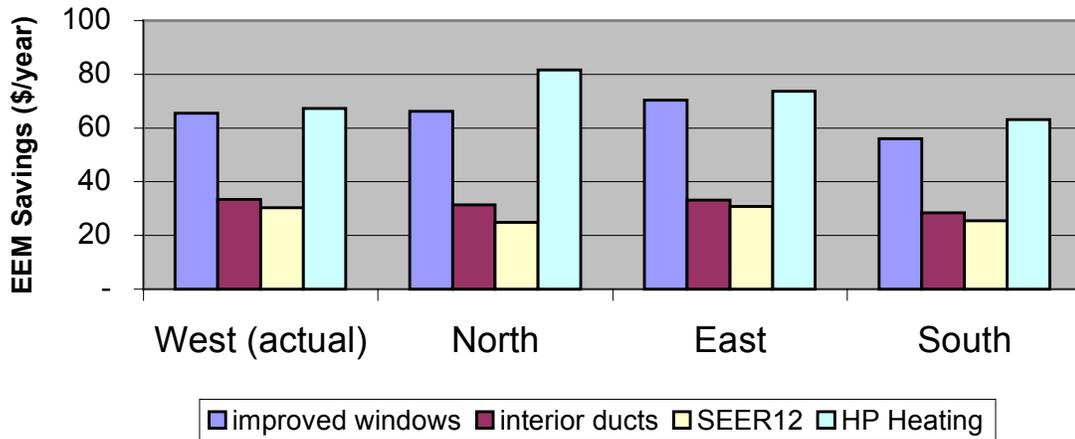


Figure 3. Energy savings for energy efficiency measures (EEM) sorted by house orientation

In addition to measure sequence and orientation, there are a number of other modeling issues to consider when evaluating a high performance house, such as zoning, buffer spaces, air infiltration, duct leakage, and air conditioner sizing. Many of these are addressed in a Technical Report developed by NREL (Hendron et al, 2001).

Reporting of Results

Consistent reporting of the analysis is important for proper and timely interpretation of the results. A description of the building and system characteristics for the starting point and for each increment in the analysis should accompany the table. Builder’s standard practice (BSP) should be identified as a separate run if it differs from the regional standard practice (RSP) base case. Table 4 shows the minimum recommended data for a sample analysis that includes DHW improvements.

Table 4. Sample Simulation Report

Description	Space Conditioning and DHW							
	Htg/Clg (kWh)	Heating (therms)	Htg/Clg Cost (\$/yr)	Measure Value (\$/yr)	Package Savings (\$/yr)	Cost Savings	Source Energy	
							kBtu	Savings
RSP Base Case	5225	190	\$ 461				75910	
Base + SEER12	4404	190	\$ 403	57.47	\$ 57	12%	67,495	11%
(BSP Base Case)								
Base + Imp. Ducts	3526	182	\$ 338	65.48	\$ 123	27%	57,552	24%
Base ++ Increased Infiltration	3658	200	\$ 356	-18.23	\$ 105	23%	61,021	20%
Base ++ Improved Windows	3055	179	\$ 303	34.49	\$ 157	34%	52,369	31%
Base ++ Increased Ceiling Insulation	2969	174	\$ 295	8.55	\$ 166	36%	50,896	33%
Base ++ 2-ton Capacity	2944	174	\$ 293	1.74	\$ 168	36%	50,641	33%
Base ++ DHW EF	2944	160	\$ 286	7.00	\$ 175	38%	48,994	35%
Base ++ Ventilation	4113	178	\$ 377	-90.82	\$ 84	18%	63,092	17%
(BA Proto)								
Proto + AFUE 94	4113	170	\$ 373	4.00	\$ 88	19%	62,151	18%

Conclusions

Although a standard set of guidelines for performance analysis of residential buildings is an appealing concept, there are fundamental difficulties. The end-use of the analysis can have an enormous impact on the requirements for accuracy, flexibility, and simplicity. Because the mission of Building America includes energy savings targets as high as 70%, it was necessary for researchers to develop a performance analysis procedure suitable for the needs of the program. The authors believe these procedures are valuable for other energy efficient homes programs that anticipate very high levels of energy savings. Of course, this level of accuracy and consistency is less essential for programs focused on minimum performance levels (such as code compliance) or moderate levels of energy savings (Energy Star).

A meaningful analysis approach for high performance homes must have four important features: (1) a clearly defined reference house that truly reflects standard practice; (2) a consistent set of operating conditions that represents realistic patterns of occupant behavior; (3) a modeling technique that accurately predicts energy savings; and (4) a reporting process that communicates essential information about the source and magnitude of energy savings.

Two important reference houses were identified for the evaluation of Building America houses. The first is *Builder Standard Practice*, which represents the house that would have been built without the influence of Building America and, therefore, provides an assessment of the direct impact of Building America on residential energy use. The second is *Regional Standard Practice*, which takes into account local construction practices and energy code requirements and is more representative of competitive houses in the marketplace. Both reference houses must include sufficient detail to allow credit for creative energy saving techniques and reductions in all major end-use loads.

In addition to a meaningful and robust reference house, it is very important to establish fair and consistent rules for defining the operating conditions of a high performance house, which can have substantial effect on energy savings calculations, especially in very energy efficient houses with passive solar design features. These operating conditions include thermostat set-points, operation of windows and draperies, magnitudes and hourly profiles of internal loads, and other influences that are under the control of the occupants. This added detail in the definition of operating conditions requires additional effort the first time a model is developed, but this detail can be embodied and saved in libraries and schedules within most modeling tools, thereby allowing much quicker analysis of future projects.

Thirdly, it is very strongly recommended that an hourly simulation program be used for calculating energy savings and peak demand, especially when bioclimatic design techniques are used, such as solar load avoidance, thermal mass, and passive ventilation. Simplified “bin” methods do not adequately capture these energy flows, which are heavily dependent on thermal behavior over time. Building America researchers commonly use a variety of whole-house hourly simulation tools, including DOE-2, EnergyPlus, and Energy 10. Most hourly simulation tools do not require excessive computational time, and they usually have very flexible and friendly user interfaces that minimize or eliminate the additional effort required to perform an accurate hourly analysis.

Finally, the reporting of the simulation results must be done in a way that communicates all of the essential information for decision-making. The report should include savings in terms of site energy, source energy, and energy cost. It should also clearly differentiate the effects of each major energy efficiency measure.

Acknowledgments

The authors thank Dick Tracey for laying the groundwork for this document and Paul Torcellini, Michael Smith, Craig Christensen, and Paul Norton of the National Renewable Energy Laboratory’s

Center for Buildings and Thermal Systems for their valuable technical contributions. In addition, the five Building America teams provided important new perspectives and critical assistance with the field tests and analytical studies cited in this report. We also express our gratitude to Ed Pollock and George James of the U.S. Department of Energy for the leadership and resources needed to complete this work.

References

California Energy Commission (CEC). 1999. *Energy Efficiency Standards for Residential and Nonresidential Buildings. California Title 24, Section 6*, Publication Number: P400-98-00. Sacramento, California: California Energy Commission.

California Energy Commission (CEC). 2001. *Nonresidential ACM Approval Manual. Section 2.4.2. Heating & Cooling Equipment*. Sacramento, California: California Energy Commission.

Hendron, R; Farrar-Nagy, S; Anderson, R; Judkoff, R; Reeves, P; and E. Hancock. 2001. *Building America House Performance Analysis Procedures*, Golden, Colorado: National Renewable Energy Laboratory.

Judkoff, R; Neymark, J. 1995. *Home Energy Rating System Building Energy Simulation Test (HERS BESTEST)*, NREL/TP-472-7332, Golden, Colorado: National Renewable Energy Laboratory.

National Association of State Energy Officials (NASEO). 1999. *National Home Energy Rating Technical Guidelines*. Alexandria, Virginia: National Association of State Energy Officials.

Energy Information Administration (EIA), U.S. Department of Energy. 1995. *Measuring Energy Efficiency in the United States Economy: A Beginning*, Chapter 7, Washington, D.C.:

REPORT DOCUMENTATION PAGE			Form Approved OMB NO. 0704-0188	
Public reporting burden for this collection of information is estimated to average 1 hour per response, including the time for reviewing instructions, searching existing data sources, gathering and maintaining the data needed, and completing and reviewing the collection of information. Send comments regarding this burden estimate or any other aspect of this collection of information, including suggestions for reducing this burden, to Washington Headquarters Services, Directorate for Information Operations and Reports, 1215 Jefferson Davis Highway, Suite 1204, Arlington, VA 22202-4302, and to the Office of Management and Budget, Paperwork Reduction Project (0704-0188), Washington, DC 20503.				
1. AGENCY USE ONLY (Leave blank)	2. REPORT DATE August 2003	3. REPORT TYPE AND DATES COVERED Conference Paper		
4. TITLE AND SUBTITLE Calculating Energy Savings in High Performance Residential Buildings Programs: Preprint			5. FUNDING NUMBERS BET3.8004	
6. AUTHOR(S) R. Hendron, S. Farrar-Nagy, R. Anderson, R. Judkoff, P. Reeves, and E. Hancock				
7. PERFORMING ORGANIZATION NAME(S) AND ADDRESS(ES) National Renewable Energy Laboratory 1617 Cole Blvd. Golden, CO 80401-3393			8. PERFORMING ORGANIZATION REPORT NUMBER NREL/CP-550-33622	
9. SPONSORING/MONITORING AGENCY NAME(S) AND ADDRESS(ES)			10. SPONSORING/MONITORING AGENCY REPORT NUMBER	
11. SUPPLEMENTARY NOTES				
12a. DISTRIBUTION/AVAILABILITY STATEMENT National Technical Information Service U.S. Department of Commerce 5285 Port Royal Road Springfield, VA 22161			12b. DISTRIBUTION CODE	
13. ABSTRACT (<i>Maximum 200 words</i>) Accurate and meaningful energy savings calculations are essential for the evaluation of residential energy efficiency programs sponsored by the U.S. Department of Energy (DOE), such as the Building America Program (a public-private partnership designed to achieve significant energy savings in the residential building sector). The authors investigated the feasibility of applying existing performance analysis methodologies such as the Home Energy Rating System (HERS) and the International Energy Conservation Code (IECC) to the high performance houses constructed under Building America, which sometimes achieve whole-house energy savings in the 50-70% range. However, because Building America addresses all major end-use loads and because the technologies applied to Building America houses often exceed what is envisioned by energy codes and home-rating programs, the methodologies used in HERS and IECC have limited suitability, and a different approach was needed. The authors have researched these issues extensively over the past several years and developed a set of guidelines that draws upon work done by DOE's Energy Information Administration, the California Energy Commission, the International Code Council, RESNET, and other organizations that have developed similar methodologies to meet their needs. However, the final guidelines are tailored to provide accurate techniques for quantifying energy savings achieved by Building America to help policymakers assess the effectiveness of the program.				
14. SUBJECT TERMS Energy savings; high performance houses; residential houses; Building America; U.S. Department of Energy; performance analysis			15. NUMBER OF PAGES	
			16. PRICE CODE	
17. SECURITY CLASSIFICATION OF REPORT Unclassified	18. SECURITY CLASSIFICATION OF THIS PAGE Unclassified	19. SECURITY CLASSIFICATION OF ABSTRACT Unclassified	20. LIMITATION OF ABSTRACT UL	