

# Analysis of Buoyancy-Driven Ventilation of Hydrogen from Buildings

**C. Dennis Barley, Keith Gawlik, Jim Ohi, Russell Hewett**

**National Renewable Laboratory  
U.S. DOE Hydrogen Safety, Codes & Standards Program**

**Presented at 2<sup>nd</sup> ICHS, San Sebastián, Spain  
September 11, 2007**

# Scope of Work

- Safe building design
- Vehicle leak in residential garage
- Continual slow leak
- Passive, buoyancy-driven ventilation (vs. mechanical)
- Steady-state concentration of  $H_2$  vs. vent size

# Prior Work

- Modeling and testing with H<sub>2</sub> and He
- Transient H<sub>2</sub> cloud formation

---

Swain et al. (1996, 2001, 2003, 2005, 2007)

Breitung et al. (2001)

Papanikolaou and Venetsanos (2005)

# Our Focus / New Findings

- Slow continual leaks
- Steady-state concentration of H<sub>2</sub>
- Algebraic equation for vent sizing
- Significant thermal effect (high outdoor temp)

# Range of “Slow” Leakage Rates


- Low end: 1.4 L/min per SAE J2578  
(vehicle manufacture quality control)
- High end: 566 L/min automatic shutdown  
(per Parsons Brinkerhoff for CaFCP)
- Consider: Collision damage or faulty maintenance
- Parametric CFD modeling:  
5.9 to 82 L/min (12 hr to 7 days/5 kg)

# Methods of Analysis

- CFD modeling (FLUENT)
- Simplified, 1-D, steady-state, algebraic analysis




**Pulte Homes, Las Vegas, NV**



**Volume of garage is 146 m<sup>3</sup>**  
**Volume of 5 kg of H<sub>2</sub> is 60 m<sup>3</sup>**  
**41% mixture is possible**  
**Well within flammable range**




# Sample CFD Model Result

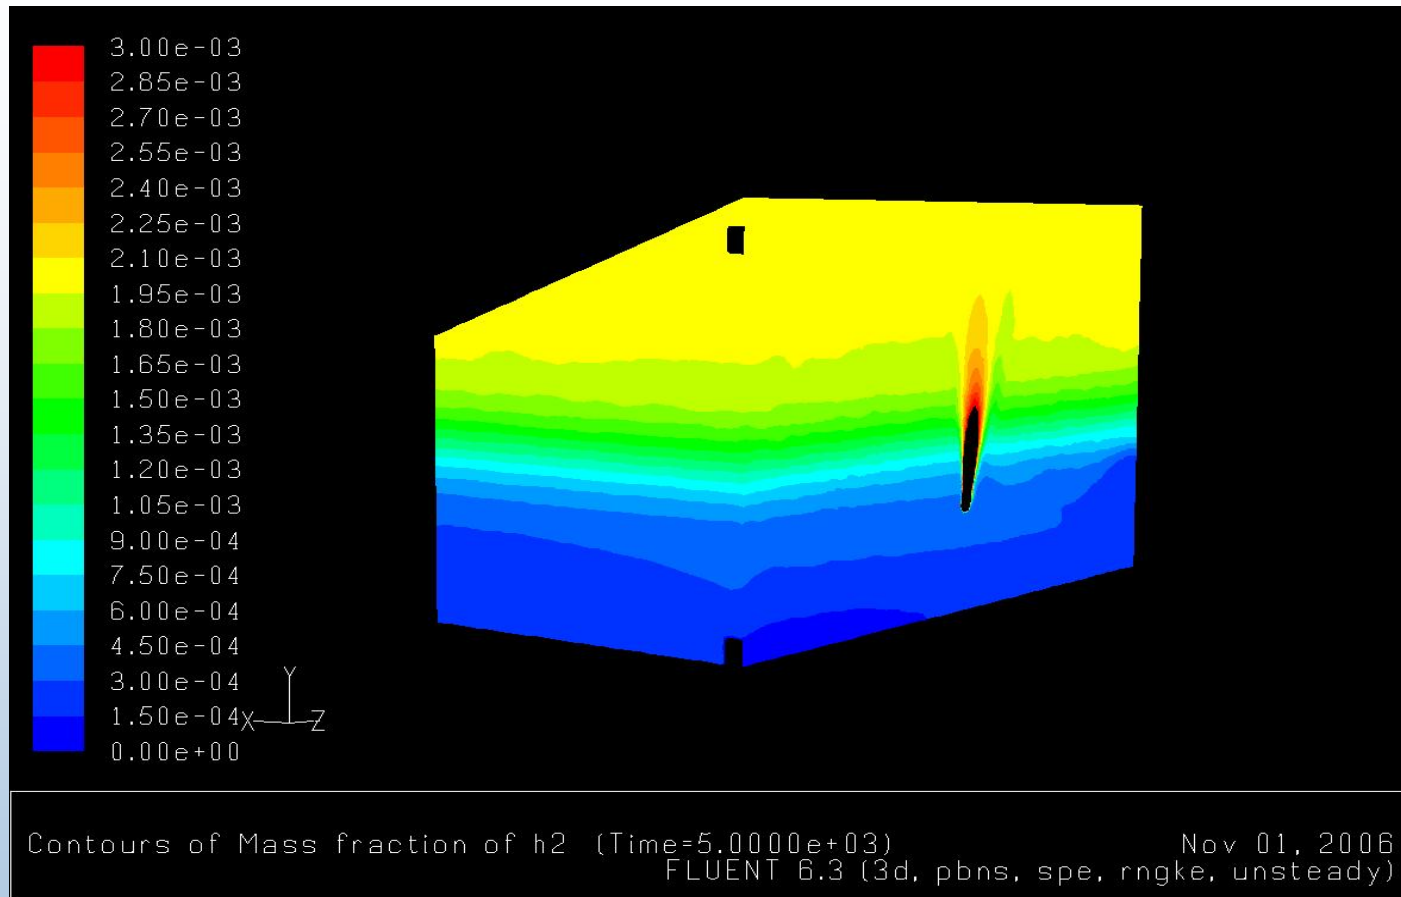

**CFD modeling used to study H<sub>2</sub> cloud. Half of garage is shown. Leak rate is 5 kg/24 hours (41.5 L/min). Vent sizes 790 cm<sup>2</sup>. Elapsed time = 83 min. Full scale is 4% H<sub>2</sub> by volume.**

# Sample CFD Model Result

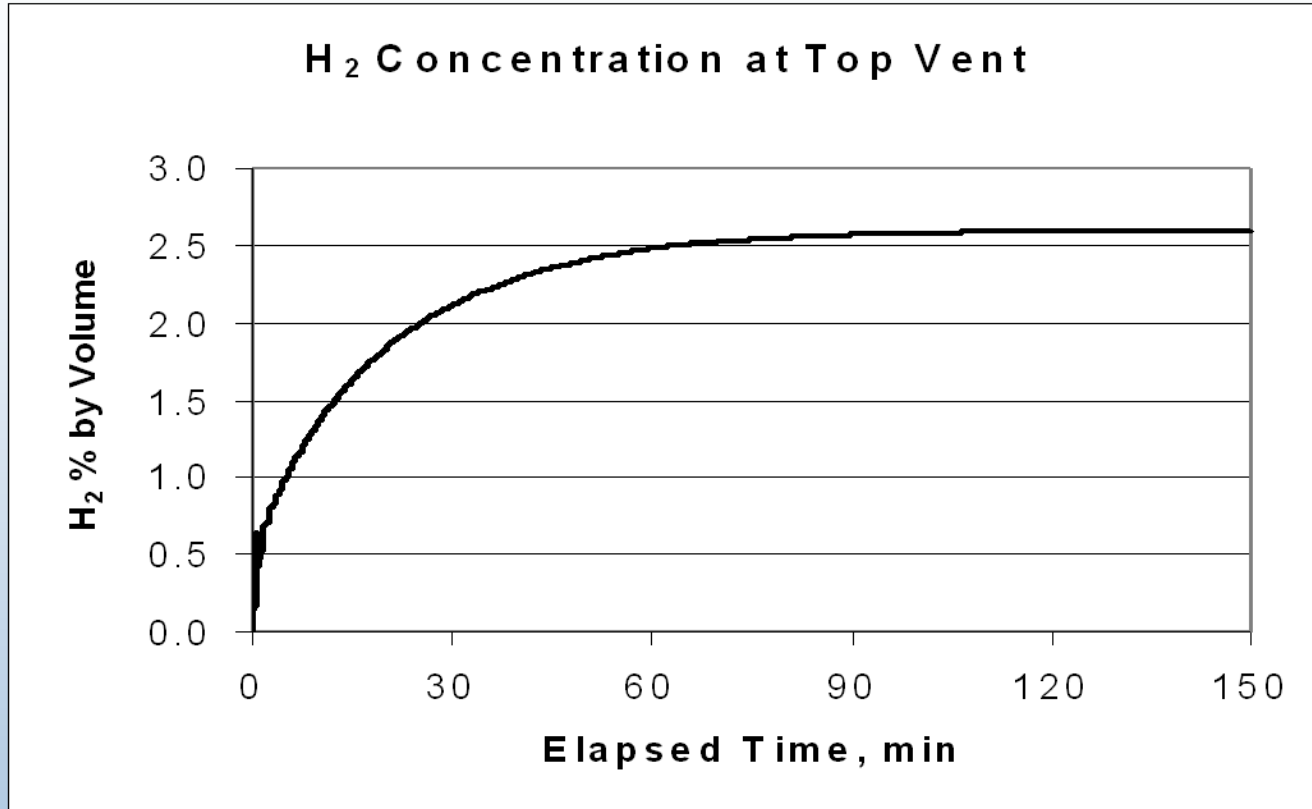


**H<sub>2</sub> concentration at top vent increases monotonically and reaches a steady value in about 90 minutes. A flammable mixture does not occur in this case.**

# Simulation Setup


- **FLUENT** version 6.3
  - Poly mesh for computational economy
  - Grid density study showed solution invariant at approx. 40,000 cells (Avg.  $\sim 1.8$  L/cell)
  - High mesh density near inlet, outlet, gas leak
  - Laminar flow model used (more conservative than turbulent models)
  - No diffusion across vents at model boundary

# Simulation Setup

- Hydrogen concentration at outlet monitored to determine steady state
- 5 kg discharge times from 12 hours to 1 week
- Low speed leak from 8-cm-diameter sphere
- Leak ~1 m above floor, one model near ceiling
- Vent sizes and height varied

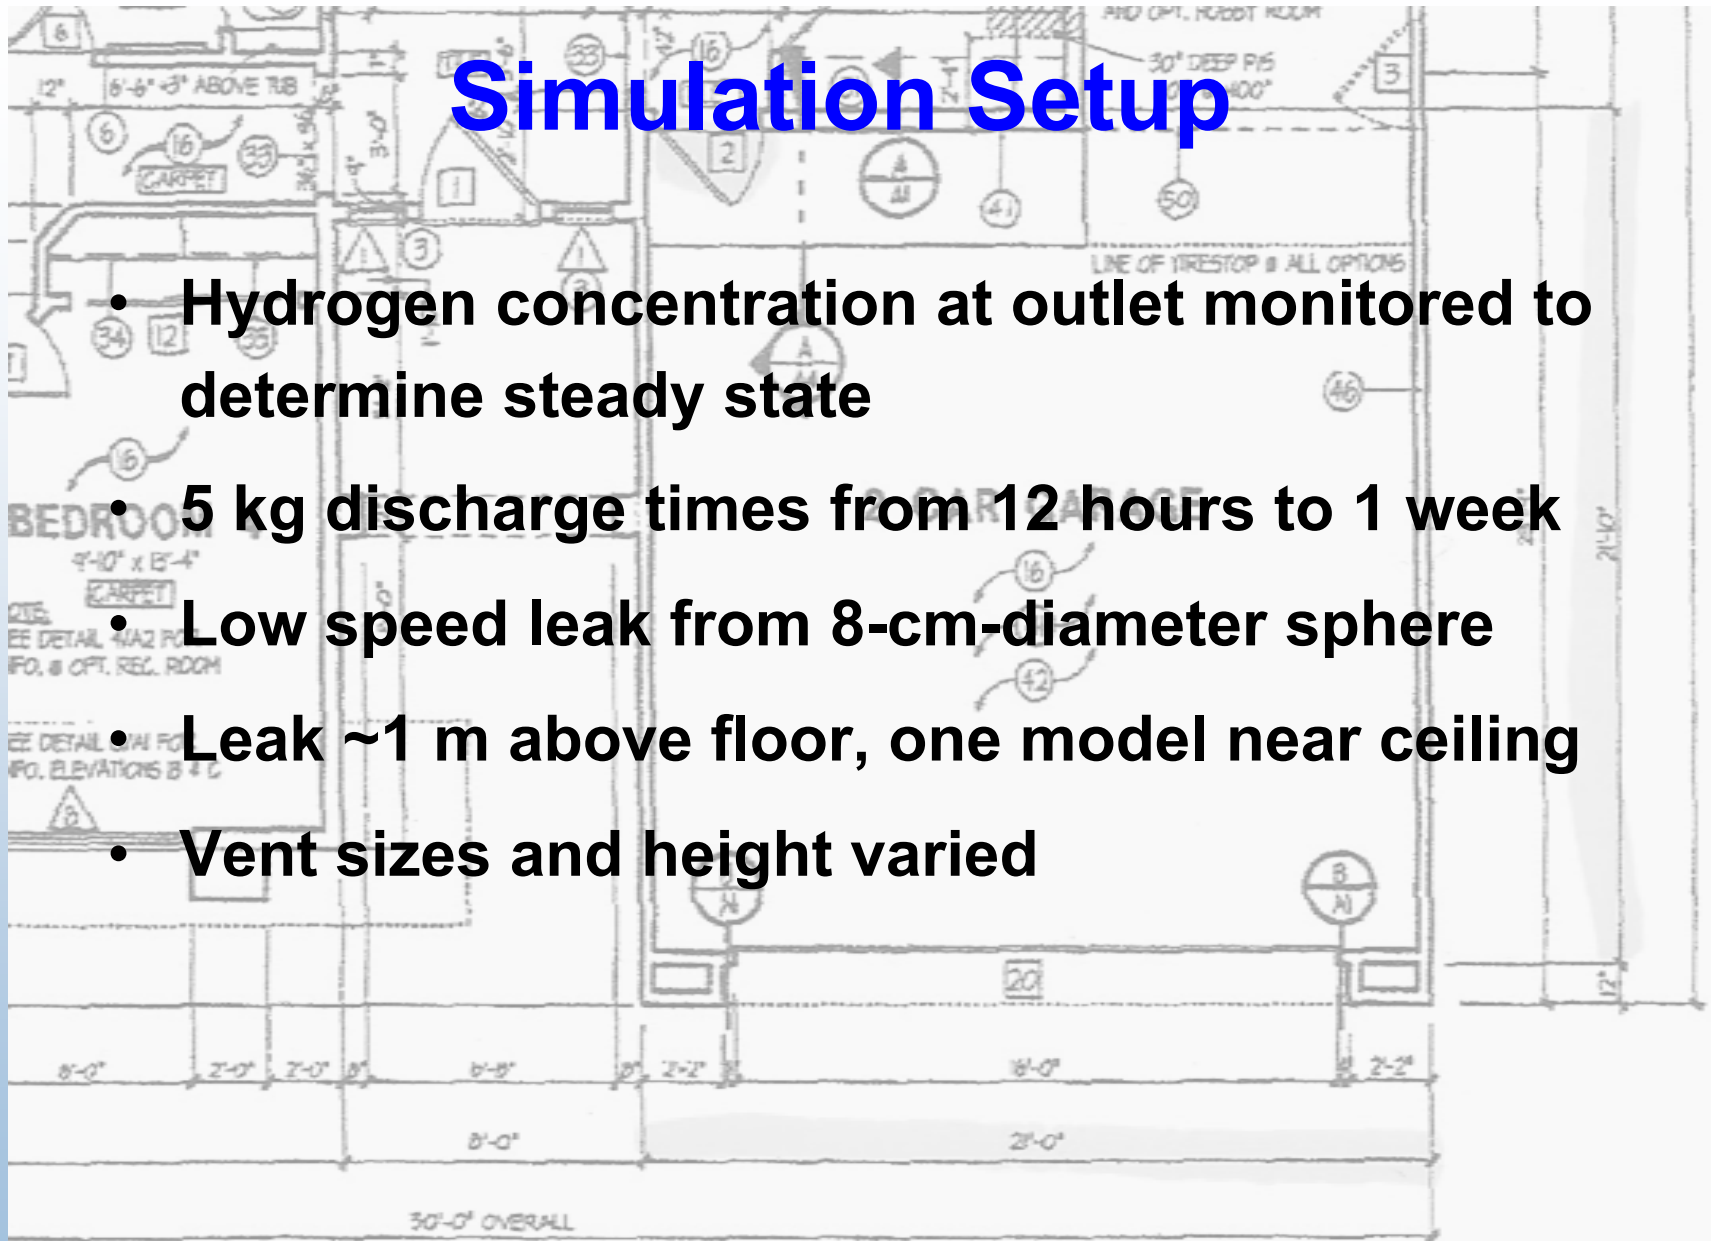


# Concept of 1-D Model

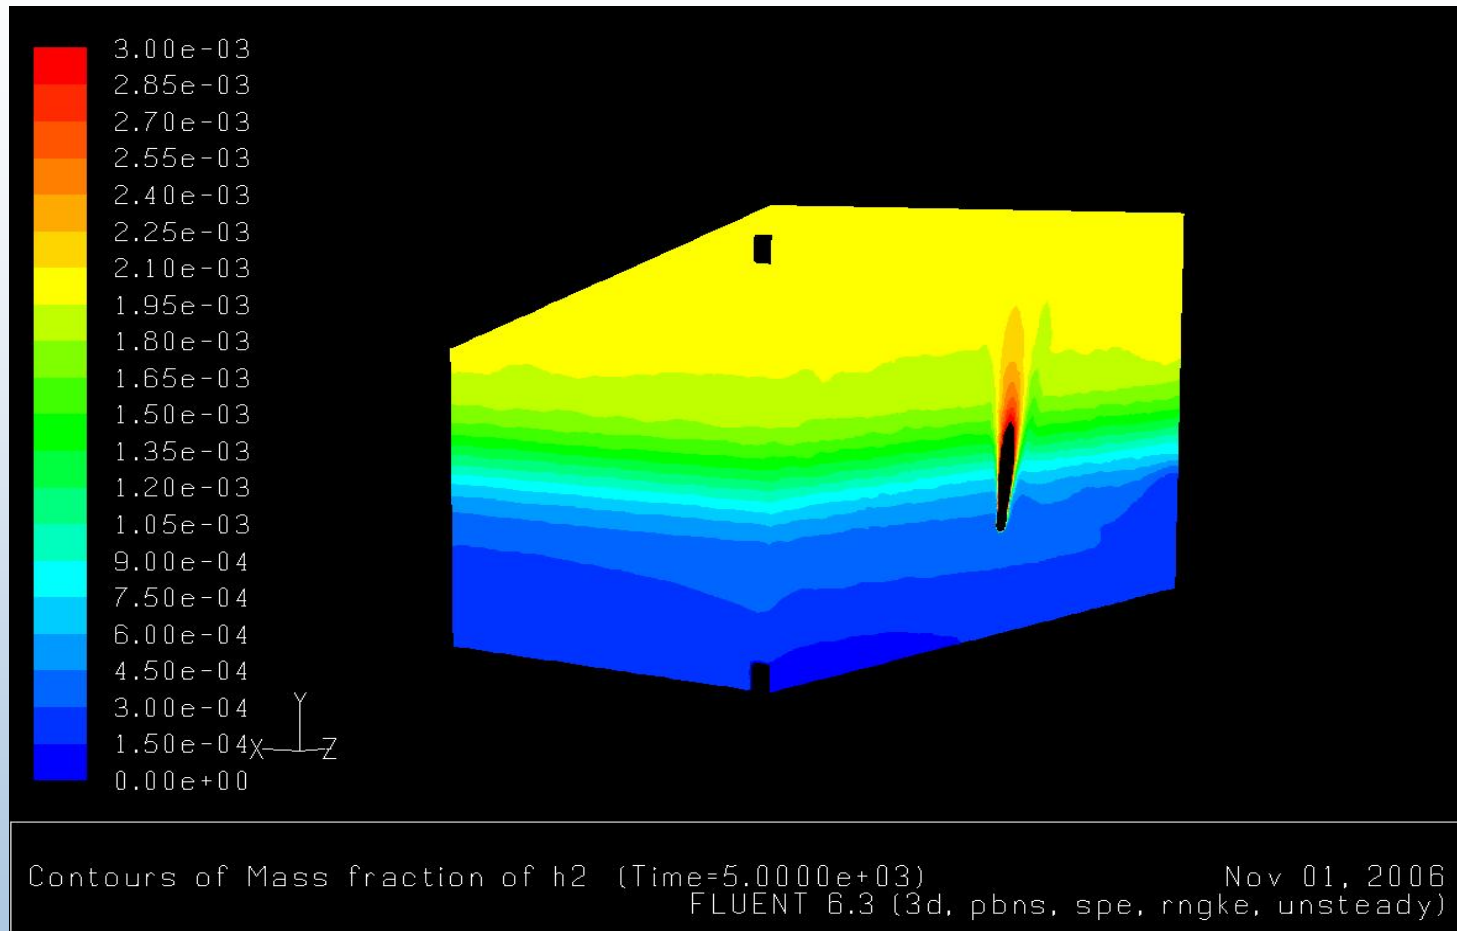

**Typical H<sub>2</sub> stratification determined by CFD model  
(steady-state condition)**

# 1-D Parametric Analysis

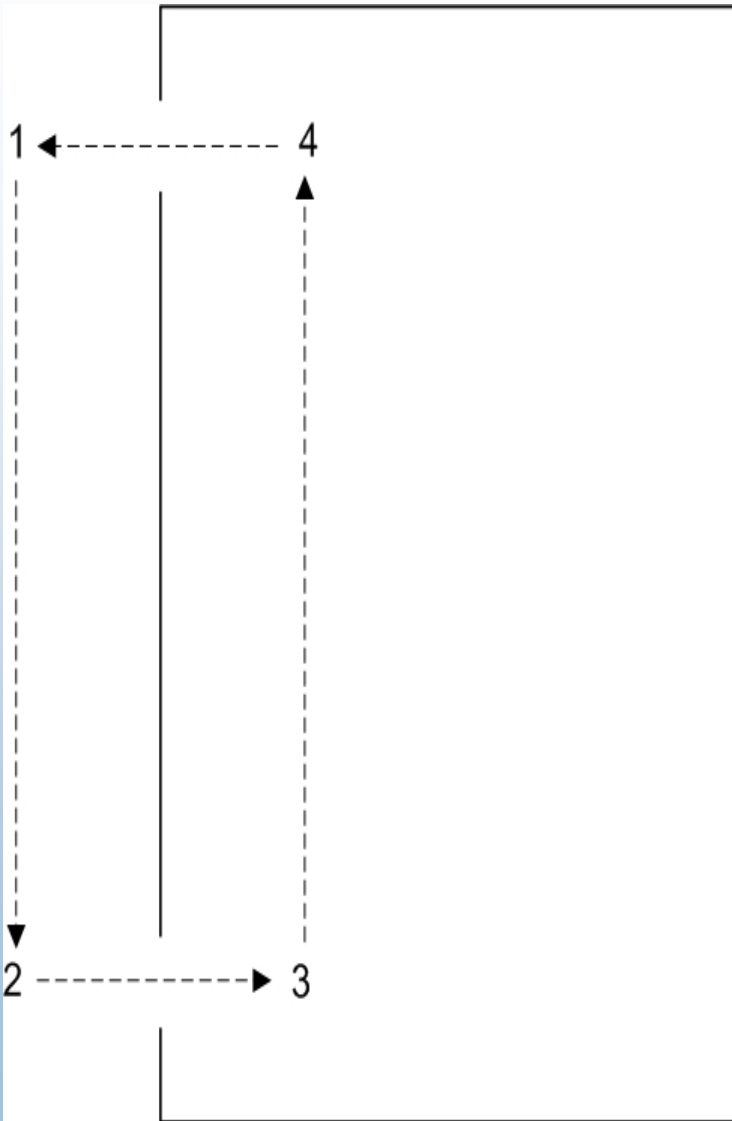

## Pressure Loop / Buoyancy

$$\Delta P_{1-2} + \Delta P_{2-3} + \Delta P_{3-4} + \Delta P_{4-1} = 0$$

$$\Delta P_{1-2} + \Delta P_{3-4} = g h \rho_{\text{air}} c_{\text{avg}} (1-\delta)$$

$P$  = Total pressure

$h$  = Height between vents


$c$  = Concentration of  $\text{H}_2$ , by volume

$\rho$  = Density

$g$  = Acceleration of gravity

$\delta$  = Density of  $\text{H}_2$  / density of air

# 1-D Parametric Analysis

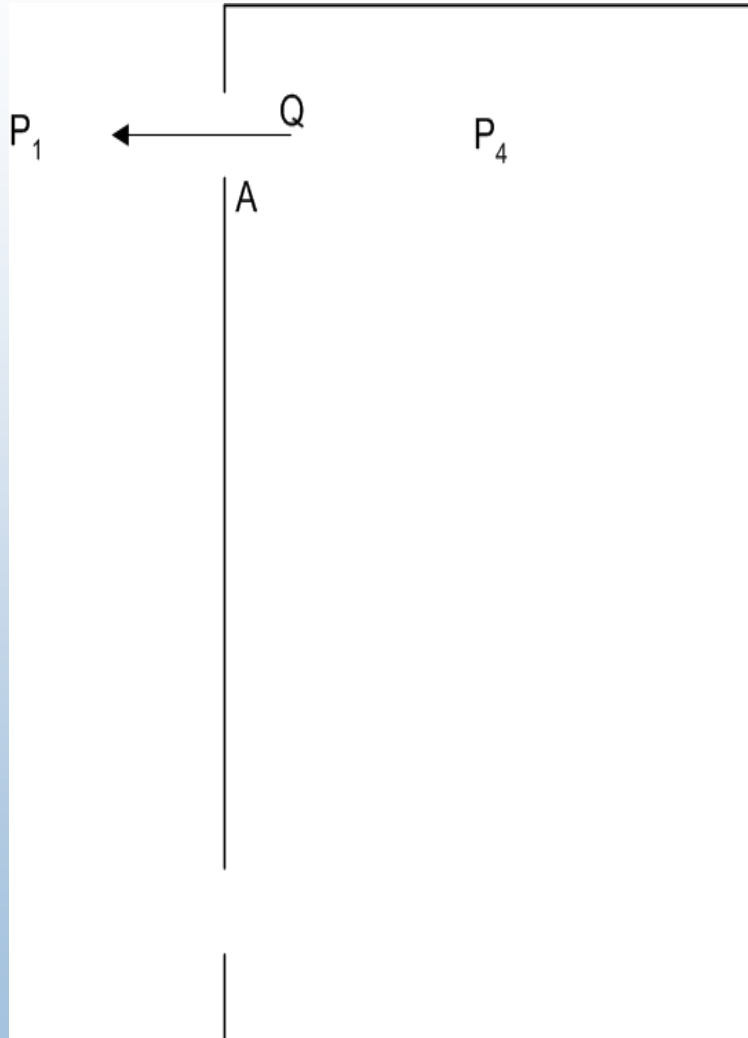

## Vent Flow vs. Pressure

$$Q = AD \sqrt{\frac{2\Delta P_{4-1}}{\rho}}$$


$Q$  = Volumetric flow rate

$A$  = Vent area

$D$  = Discharge coefficient

(Similar at bottom vent)

# 1-D Parametric Analysis

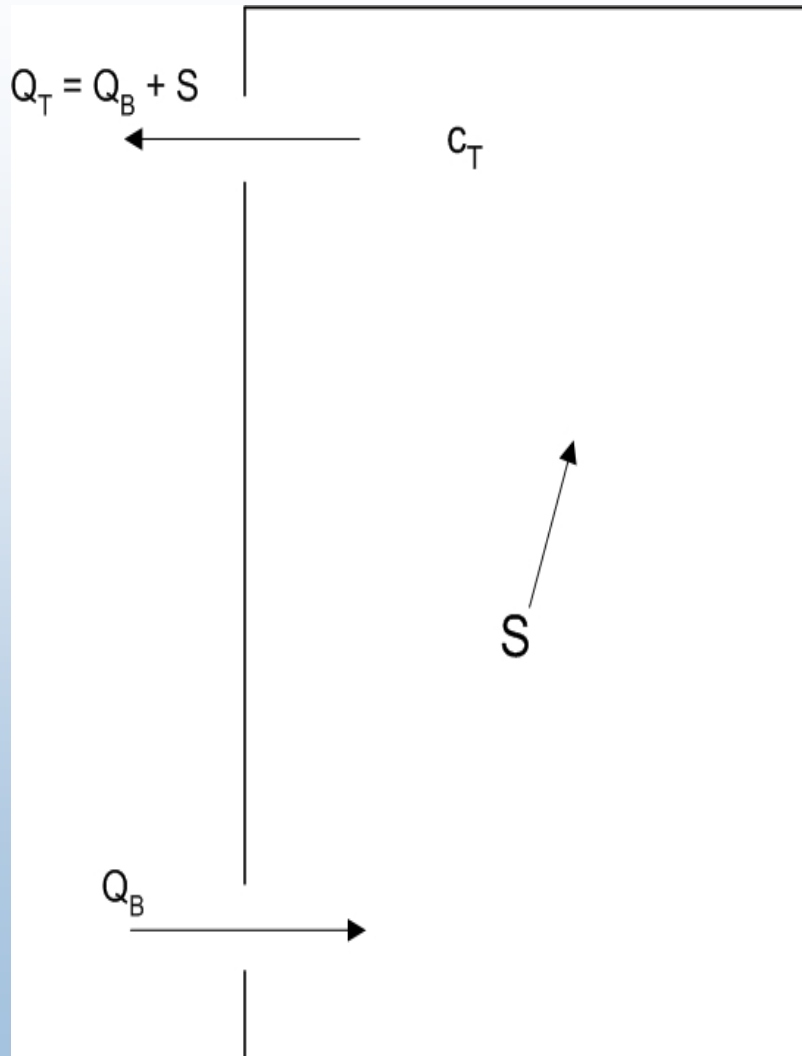

## Steady-State Mass Balances

$$Q_T c_T = S$$

$Q$  = Volumetric flow rate

$c_T$  =  $H_2$  concentration at top vent,  
by volume

$S$  = Volumetric  $H_2$  source rate



# 1-D Parametric Analysis


## Isothermal Vent-Sizing Equation:

$$F \equiv \frac{AD}{S} \sqrt{2gh} = \phi^{\frac{1}{2}} \left[ \frac{1 - C_T(1 - \delta) + (1 - C_T)^2}{(1 - \delta) C_T^3} \right]^{\frac{1}{2}}$$

where:

- F = Vent sizing factor, dimensionless
- A = Vent area (top = bottom), m<sup>2</sup>
- C<sub>T</sub> = H<sub>2</sub> concentration at top vent, by volume (0-1)
- D = Vent discharge coefficient (0-1)
- S = Source rate of H<sub>2</sub> (leak rate), m<sup>3</sup>/s
- g = Acceleration of gravity = 9.81 m/s<sup>2</sup>
- h = Height between vents, m
- δ = Ratio of densities of H<sub>2</sub>/Air = 0.0717
- φ = Stratification factor = C<sub>T</sub>/C<sub>avg</sub> (C<sub>avg</sub> = average over height)

# Comparison of Models

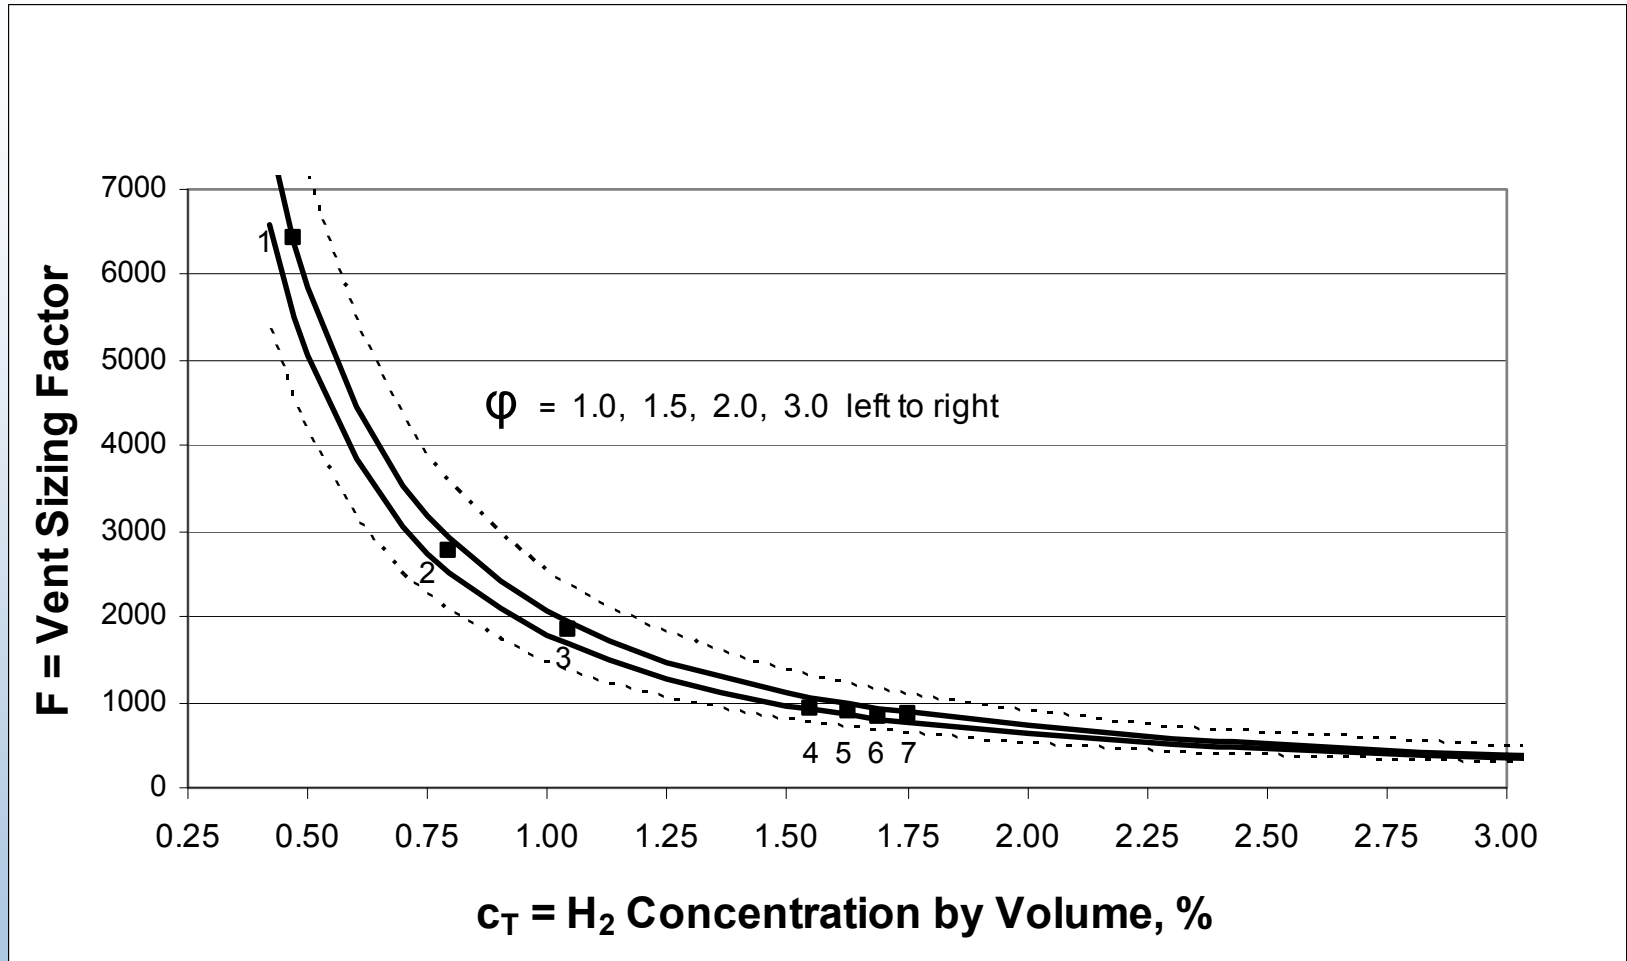

**Curves illustrate isothermal vent-sizing equation.  
Points 1-7 are CFD results.**

# Series of CFD Cases

Specifications, Results	CFD Case						
	1	2	3	4	5	6	7
Leak-Down Time, hr/5 kg	168	72	48	24	24	24	12
Vent Size, cm <sup>2</sup>	788	788	788	788	788	788	1576
Vent Offset, cm	0.0	0.0	0.0	0.0	15.2	30.5	0.0
Vent Height, m	3.650	3.650	3.650	3.650	3.345	3.040	3.599
H <sub>2</sub> Conc. at top vent, % Vol	0.47	0.79	1.04	1.55	1.63	1.69	1.75
Straification Factor ( $\phi$ )	1.65	1.67	1.67	1.52	1.58	1.59	1.88
Discharge Coeff. (D*)	0.952	0.952	0.952	0.965	0.948	0.944	0.903

# Ranges of Parameters

- Stratification factor ( $\varphi$ ):  
1.52 to 1.88
- Apparent discharge coefficient ( $D^*$ ):  
0.903 to 0.965

$D^*$  higher than typical  $D$  (0.60 to 0.70)


$D^*$  includes momentum effects

Further study needed (experimental)

# Reverse Thermocirculation

When outdoor temperature is higher than indoor (garage) temperature, thermal circulation opposes H<sub>2</sub>-buoyancy-driven circulation.

# Thermal Case Study

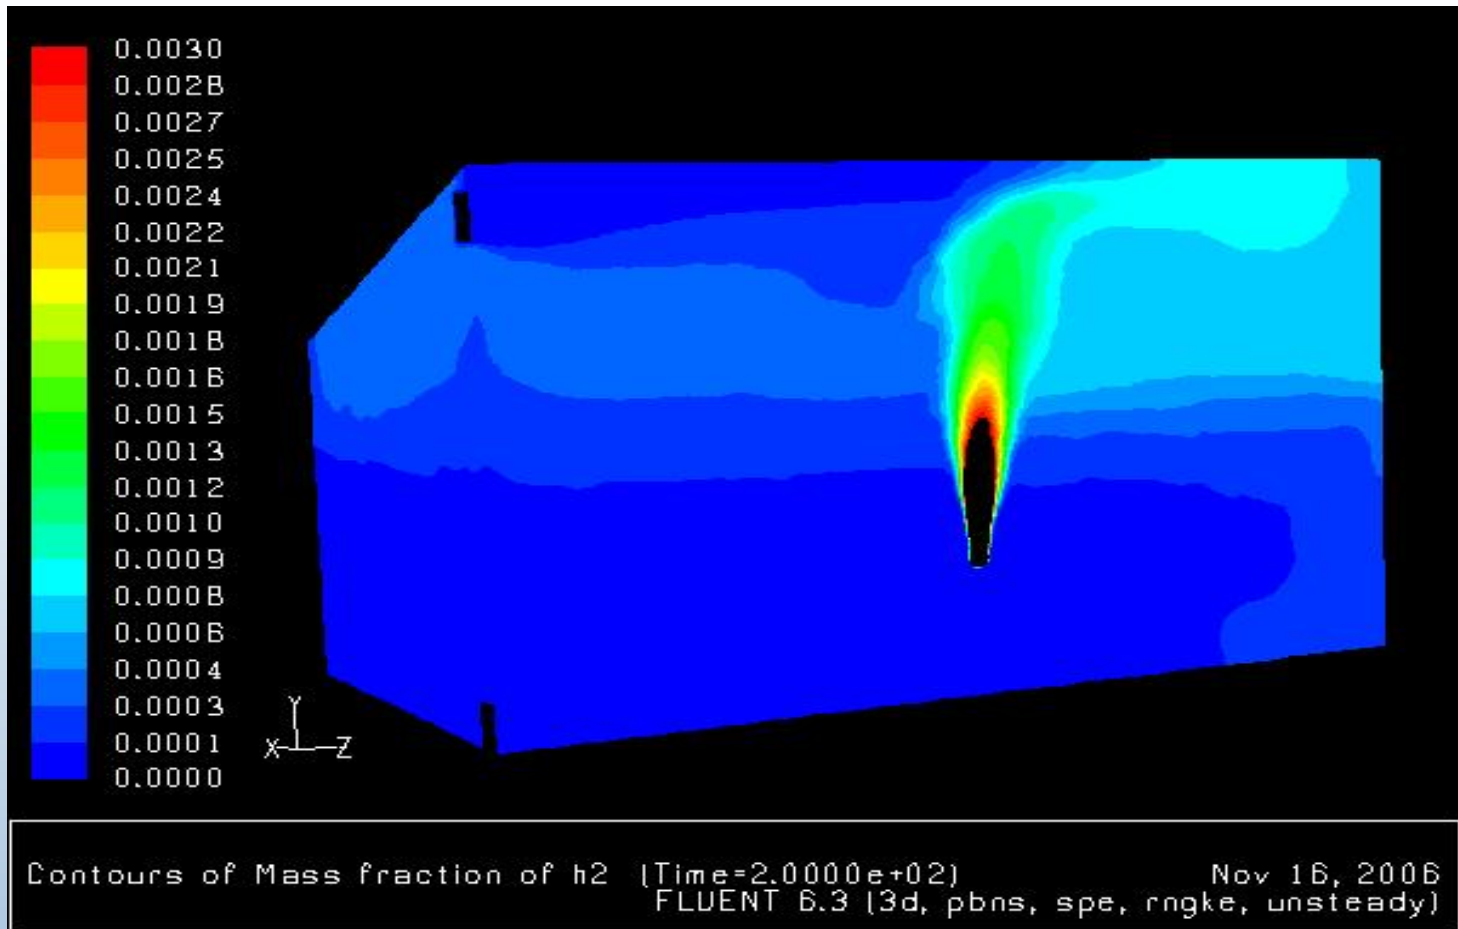


**Leak rate = 5 kg/12 hours. Vent size = 1,580 cm<sup>2</sup>.**

**$T_{\text{amb}} - T_{\text{cond}} = 20^{\circ}\text{C}$ . Elapsed time = 3.3 min.**

**Full scale = 4% H<sub>2</sub> by volume.**

# Thermal Case Study

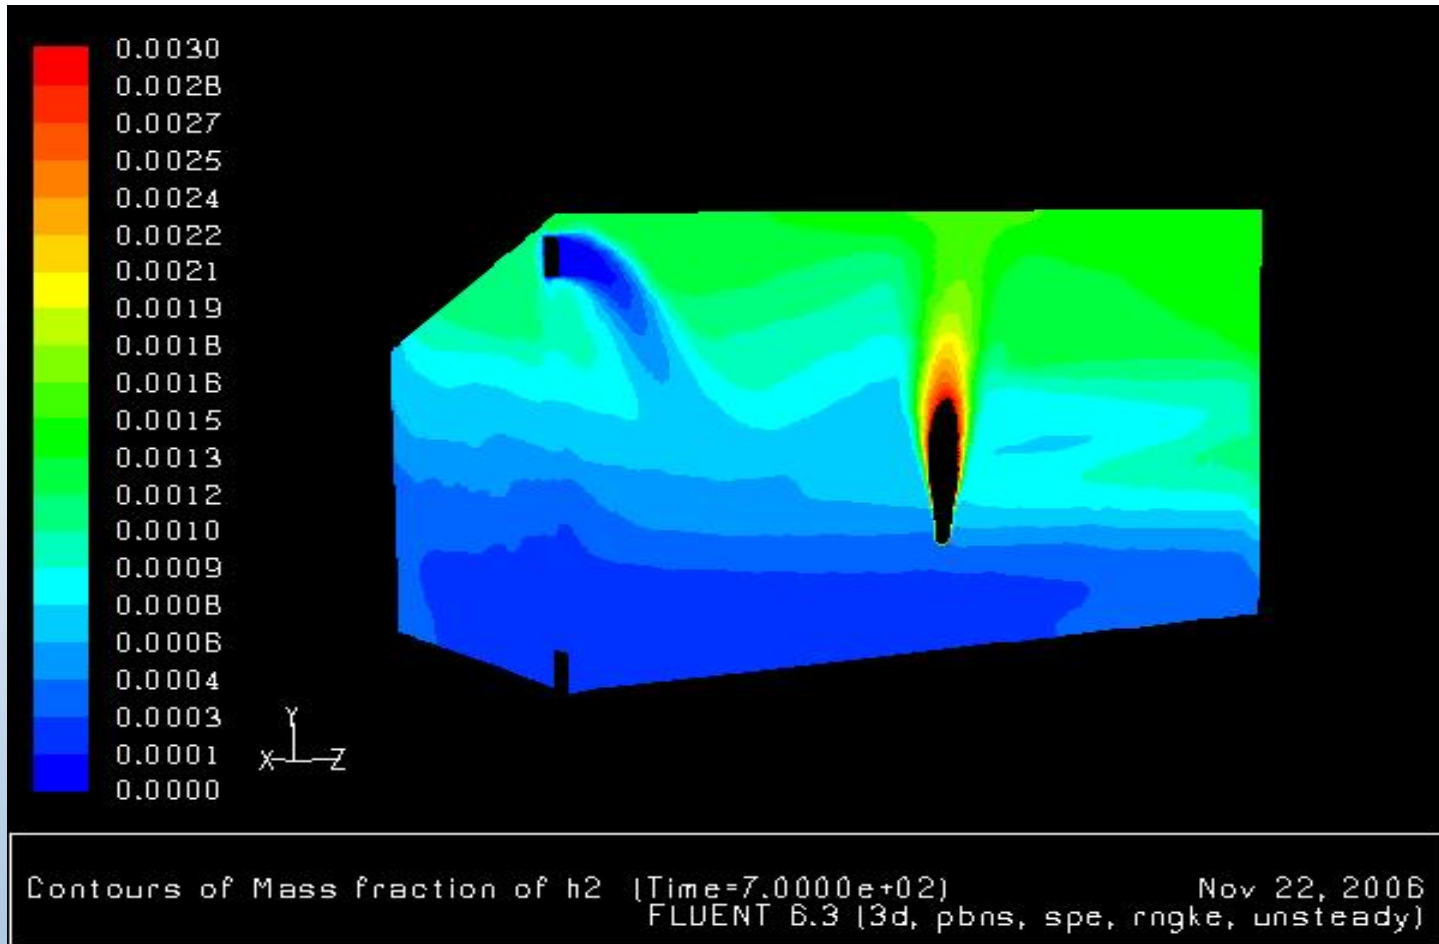


**Leak rate = 5 kg/12 hours. Vent size = 1,580 cm<sup>2</sup>.**

**$T_{\text{amb}} - T_{\text{cond}} = 20^{\circ}\text{C}$ . Elapsed time = 11.7 min.**

**Full scale = 4% H<sub>2</sub> by volume.**

# Thermal Case Study

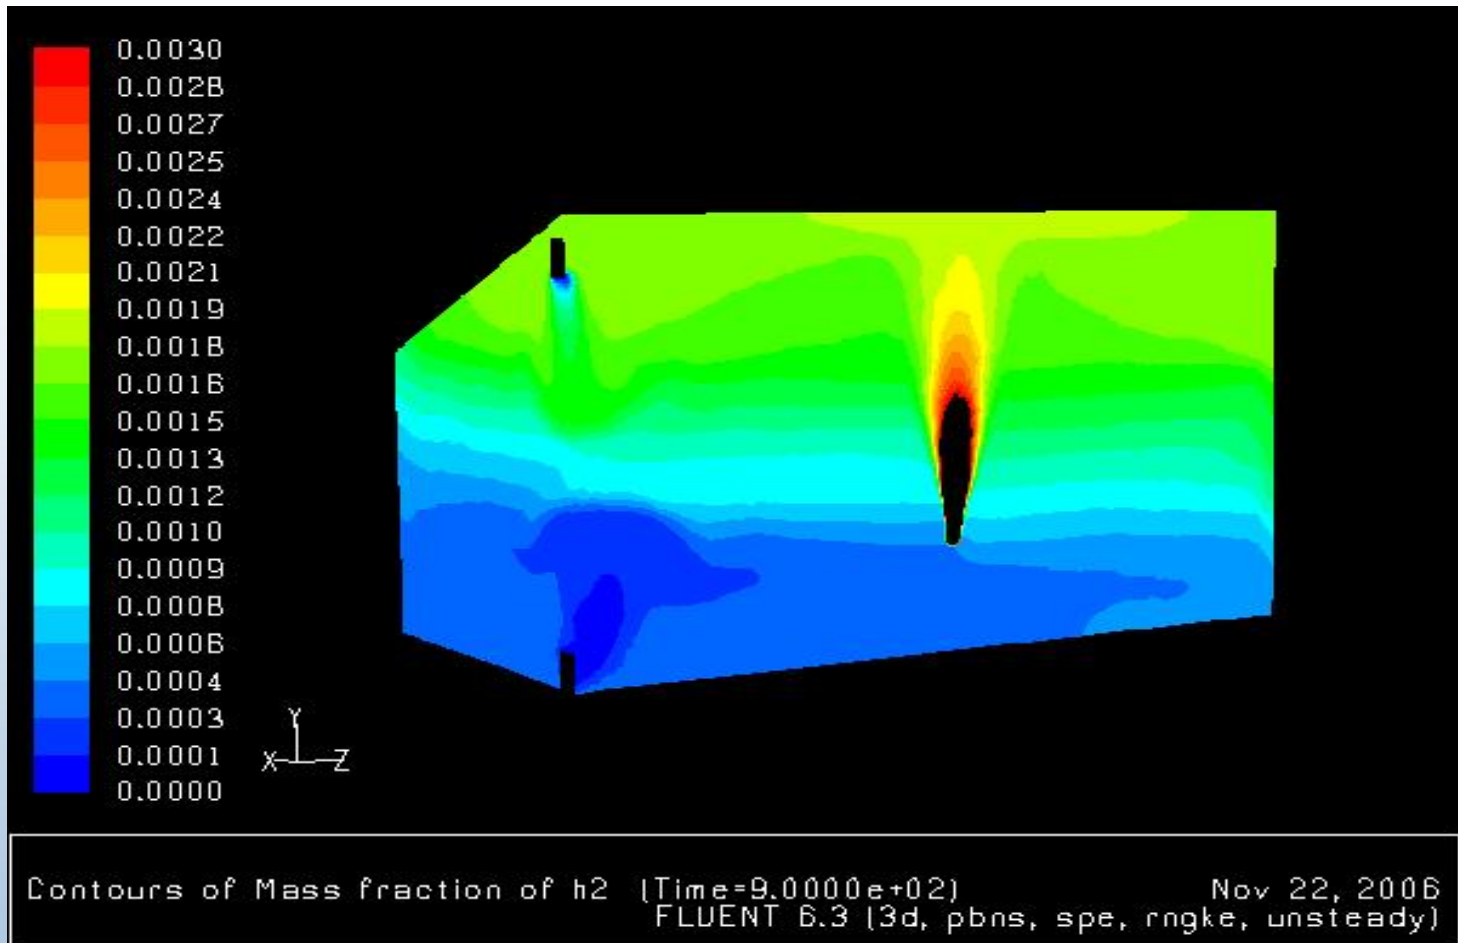


**Leak rate = 5 kg/12 hours. Vent size = 1,580 cm<sup>2</sup>.**

**$T_{\text{amb}} - T_{\text{cond}} = 20^{\circ}\text{C}$ . Elapsed time = 15 min.**

**Full scale = 4% H<sub>2</sub> by volume.**



# Thermal Case Study

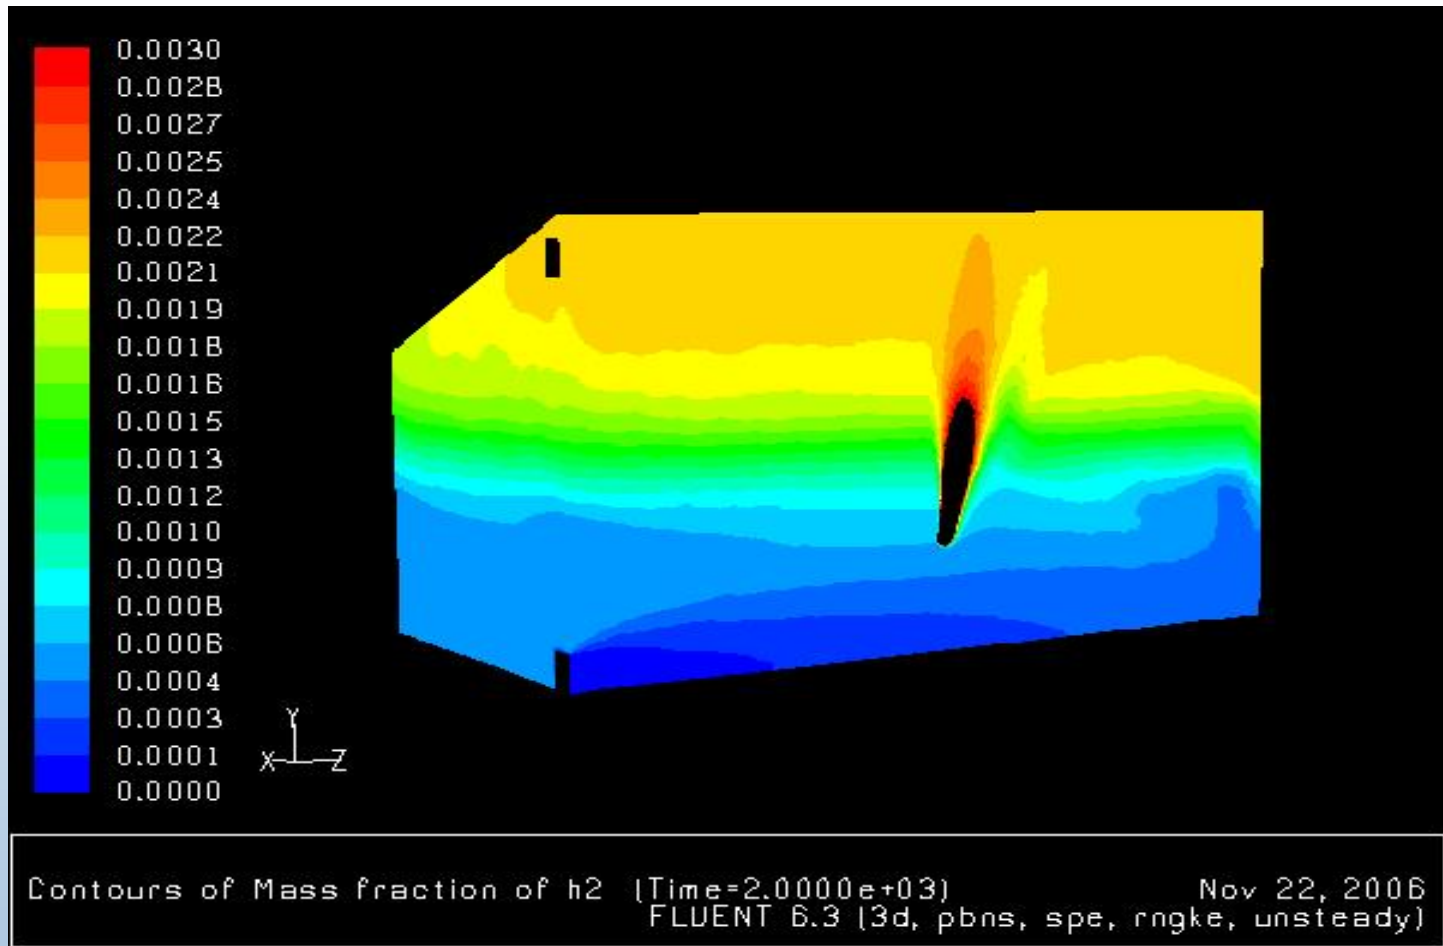


**Leak rate = 5 kg/12 hours. Vent size = 1,580 cm<sup>2</sup>.**

**$T_{\text{amb}} - T_{\text{cond}} = 20^{\circ}\text{C}$ . Elapsed time = 33 min.**


**Full scale = 4% H<sub>2</sub> by volume.**

# Thermal Case Study

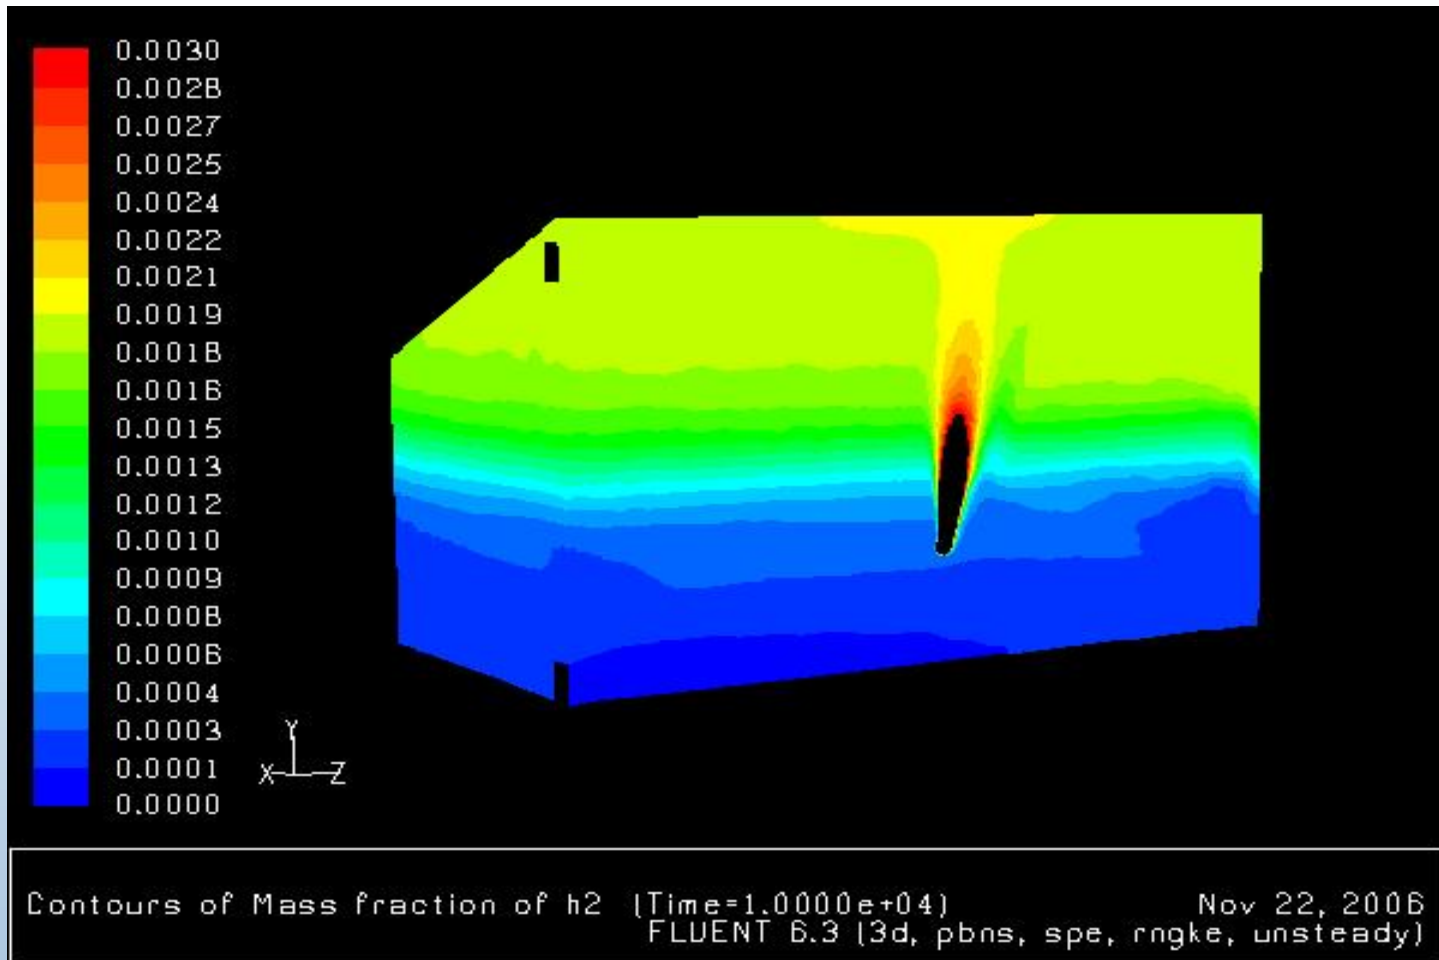

Leak rate = 5 kg/12 hours. Vent size = 1,580 cm<sup>2</sup>.  
 $T_{\text{amb}} - T_{\text{cond}} = 20^{\circ}\text{C}$ . Elapsed time = 2.8 hr (steady state).  
Full scale = 4% H<sub>2</sub> by volume.

# Thermal Case Study

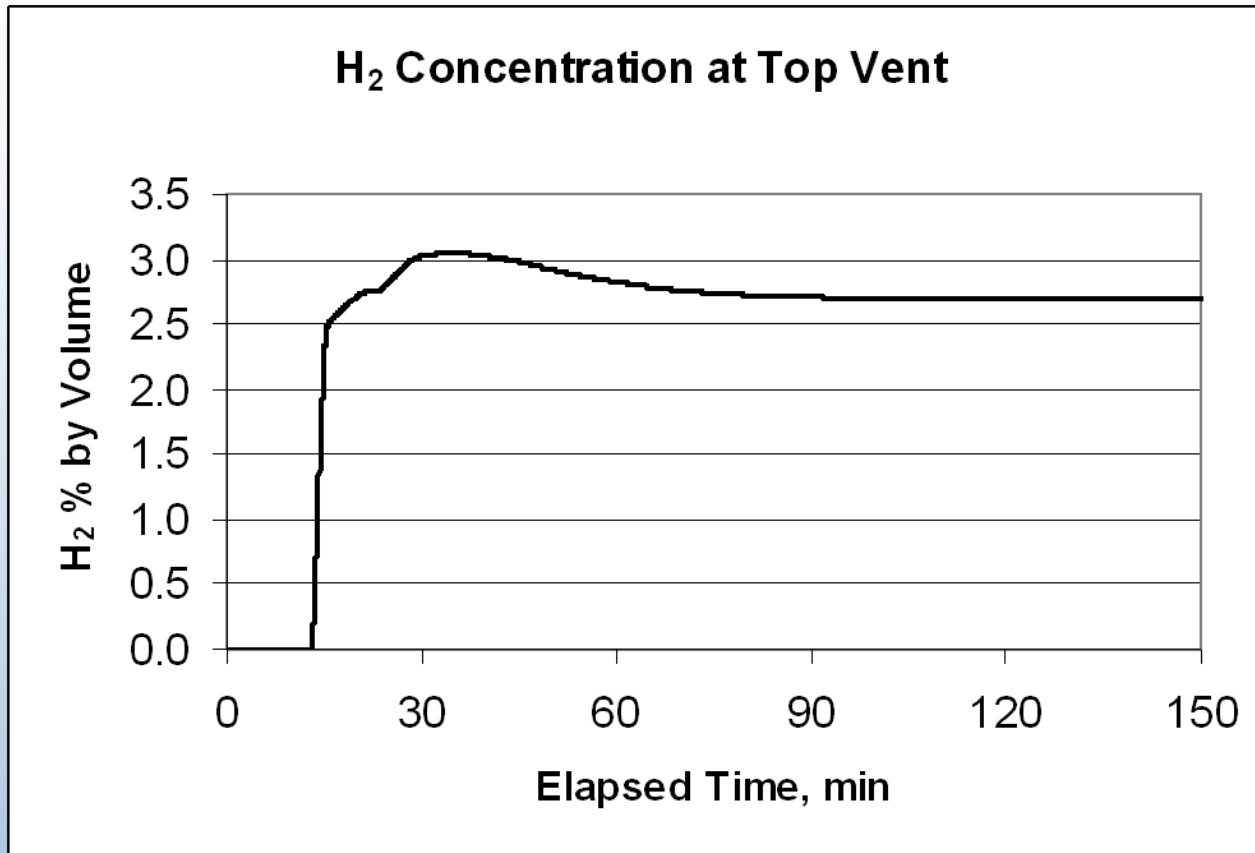

**Leak rate = 5 kg/12 hours. Vent size = 1,580 cm<sup>2</sup>.**

$$T_{\text{amb}} - T_{\text{cond}} = 20^{\circ}\text{C}.$$

# **A Perfect Storm**

## **Extreme thermal scenario**

**Garage strongly coupled to house & ground**

**Garage weakly coupled to ambient**

**Hot day, cool ground, low A/C setpoint**

**Small vents—sized for 2% H<sub>2</sub> max with 1-D model**

# A Perfect Storm



Heartland Homes, Pittsburgh, PA


# **A Perfect Storm**

## **Ambient conditions modeled**

- **Ambient temp. = 40.6°C (Approx. max. in Denver)**
- **Ground temp = 10°C (Denver, mid-April)**
- **A/C setpoint = 21.1°C (Rather low)**

# Reverse Flow Scenario

## H<sub>2</sub> exiting through bottom vent

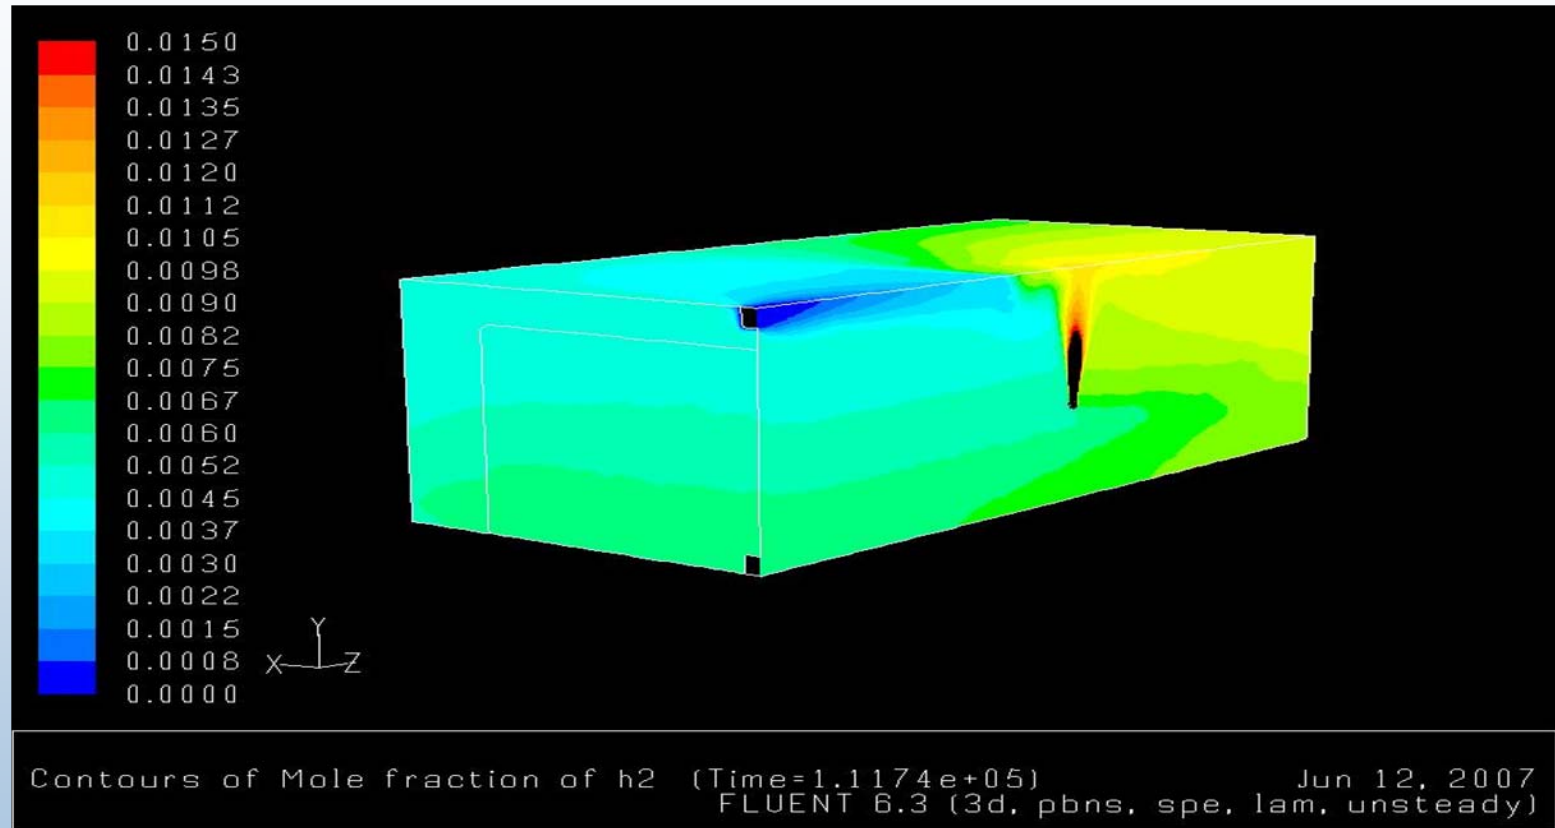

**Case 9. Leak rate = 5 kg/7 days. Vent size = 494 cm<sup>2</sup>.  
Elapsed time = 31 hr (steady state).  
Full scale = 1.5% H<sub>2</sub> by volume.**


# A Perfect Storm Results

- Case 8 (1-day leak):  
Vents from top, 2.3% max
- Case 9 (7-day leak):  
Vents from bottom, 1.0% max
- Case 10 (3-day leak):  
Vents from top, 4.8% max



# A Perfect Storm

## Worst thermal case we modeled

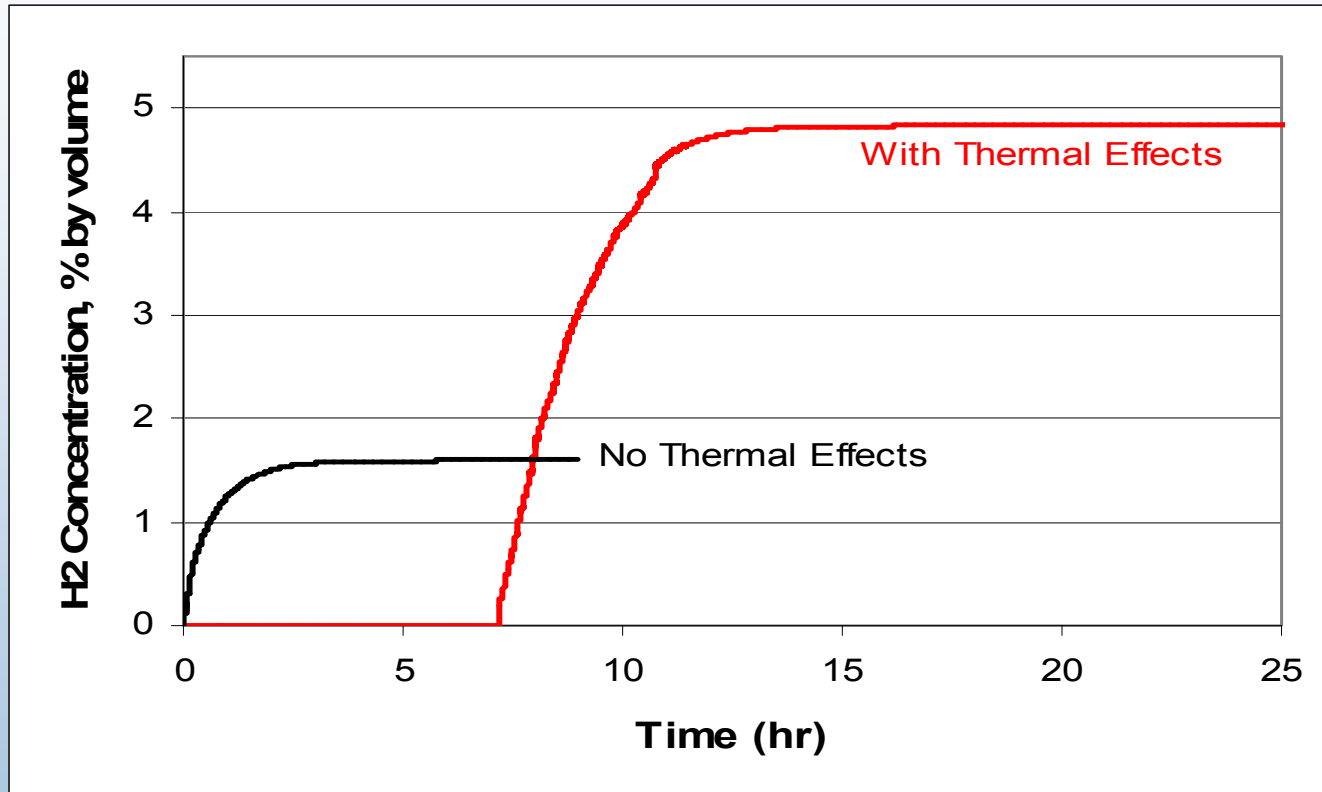

**Case 10. Leak rate = 5 kg/3 days. Vent size = 405 cm<sup>2</sup>.**

# Conclusions

1. The leakage rates that will occur and their frequencies are unknown.

Further study of leakage rates is needed to put parametric results into perspective.

2. Our CFD model has not yet been validated against experimental data.
  - Uncertainty in results
  - Future work

# Conclusions

3. The 1-D model ignores thermal effects, but otherwise provides a safe-side estimate of H<sub>2</sub> concentration by ignoring momentum effects (pending model validation).
4. Indicated vent sizes would cause very low garage temperatures in cold climates, for leak rates of roughly 6 L/min and higher (leak-down in 1 week or less).

# Conclusions

5. Reverse thermocirculation:
  - Can occur in nearly any climate
  - The worst case we modeled increased the expected H<sub>2</sub> concentration from 2% to 5%. This is a significant risk factor,
  - Likelihood of occurrence may be low, judging by the lengths we went to in order to identify a significant example.

# Conclusions

6. Mechanical ventilation is alternative approach to safety.
  - H<sub>2</sub>-sensing fan controller is recommended.
  - Research is needed to develop a control system that is sufficiently reliable and economical for residential use.