

# Reliability Benefits of Dispersed Wind Resource Development

*Michael Milligan  
Rory Artig*

*Presented at  
Windpower '98  
Bakersfield, CA  
April 27–May 1, 1998*



National Renewable Energy Laboratory  
1617 Cole Boulevard  
Golden, Colorado 80401-3393  
A national laboratory of the U.S. Department of Energy  
Managed by Midwest Research Institute  
for the U.S. Department of Energy  
under contract No. DE-AC36-83CH10093

Work performed under task number WE802020

May 1998

## NOTICE

This report was prepared as an account of work sponsored by an agency of the United States government. Neither the United States government nor any agency thereof, nor any of their employees, makes any warranty, express or implied, or assumes any legal liability or responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by trade name, trademark, manufacturer, or otherwise does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States government or any agency thereof. The views and opinions of author(s) expressed herein do not necessarily state or reflect those of the United States government or any agency thereof.

Available to DOE and DOE contractors from:  
Office of Scientific and Technical Information (OSTI)  
P.O. Box 62  
Oak Ridge, TN 37831  
Prices available by calling (423) 576-8401

Available to the public from:  
National Technical Information Service (NTIS)  
U.S. Department of Commerce  
5285 Port Royal Road  
Springfield, VA 22161  
(703) 487-4650



# RELIABILITY BENEFITS OF DISPERSED WIND RESOURCE DEVELOPMENT

Michael Milligan  
National Renewable Energy Laboratory  
1617 Cole Boulevard  
Golden, Colorado 80401-3393  
USA

Rory Artig  
Minnesota Department of Public Service  
121 7th Place East, Suite 200  
St. Paul, Minnesota 55101-2145  
USA

## ABSTRACT

This paper uses a production-cost/reliability model to analyze the reliability of several wind sites in the state of Minnesota. The analysis finds that the use of a model with traditional reliability measures does not produce consistent, robust results. An approach based on fuzzy set theory is applied in this paper, with improved results. Using such a model, we find that system reliability can be optimized with a mix of disperse wind sites.

## INTRODUCTION

Generating capacity that is available during the utility peak period is worth more than off-peak capacity. Wind power from a single location might not be available during enough of the peak period to provide sufficient value. However, if the wind power plant is developed over geographically disperse locations, the timing and availability of wind power from these multiple sources could provide a better match with the utility's peak load than a single site. There are other issues that arise when considering disperse wind plant development. Singular development can result in economies of scale and might reduce the costs of obtaining multiple permits and multiple interconnections. However, disperse development can result in cost efficiencies if interconnection can be accomplished at lower voltages or at locations closer to load centers.

Several wind plants are in various stages of planning or development in the United States. Although some of these are small-scale demonstration projects, significant wind capacity has been developed in Minnesota, with additional developments planned in Wyoming, Iowa and Texas. As these and other projects are planned and developed, there is a need to perform analysis of the value of geographically disperse sites on the reliability of the overall wind plant.

## RELIABILITY IN A RESTRUCTURED INDUSTRY

Wholesale and retail markets for electricity are undergoing significant change in many parts of the United States as the utility industry is restructured. In most if not all cases, the new market will consist of a larger number of players and institutions, and more complicated transactions and contract paths between seller and buyer. Although the traditional utility of the past will look very different in the future, many aspects of utility analysis and planning will continue to be carried out, even though it is likely that other participants in the market may take over some of these roles. For example, a recent international panel of electric-system reliability experts agreed that: (1) electrical reliability in the United States is very good overall today, particularly as viewed in the context of generation reliability; (2) the transactions in the wholesale market that will arise from the restructuring of the industry will be far more complex than they were in the past; and (3) system reliability will likely worsen, but will in any case continue to be an important issue in a restructured market (panel session: Maintaining Reliability in a Competitive Environment, Probabilistic Methods Applied to Power Systems 5<sup>th</sup> International Conference, Vancouver, BC, September 1997).

As electric market product unbundling occurs, sellers in the wholesale market for electricity will find it to their advantage to be able to specify the quantity of electricity available and the time of availability. Because wind power plants are driven by the stochastic nature of the wind itself, difficulties can arise for a wind plant operator. An operator who contracts for a sale of energy during periods of variable wind power output might be required to pay a significant penalty if the actual power diverges significantly from the level specified by contract. In previous work Milligan, Miller, and Chapman (1995) provided estimates of the benefit of accurate wind forecasting to the utility. To the extent that an accurate forecast is available, contract deviations, and therefore penalties, can be significantly reduced.

## APPROACH

In this paper, we use hourly wind-speed data from six geographically diverse sites collected by the Minnesota Department of Public Service to provide some insight into the potential benefits of disperse wind plant development. Our analysis focuses on the installation of 825 MW of wind power plant capacity in the state of Minnesota. This corresponds to the current and planned wind development at Buffalo Ridge, plus the additional 400 MW that Northern States Power will evaluate in the near future. The work we describe here is part of a larger project undertaken by the National Renewable Energy Laboratory (NREL) and the Minnesota Department of Public Service. Part of this project has also been described by Milligan and Artig (1998a). We anticipate a more detailed technical report will appear later this year.

In this work we define “dispersed wind energy development” to mean that wind generators are built at several sites, as contrasted with development at a single location. We do not do any analysis that involves the so-called “distributed utility” concept. We provide hourly wind power from each of these sites to an electric reliability simulation model. This model uses generating plant characteristics of the generators within the state of Minnesota to calculate various reliability indices. Because we lack data on wholesale power transactions, we do not include them in our analysis, and we reduce the hourly load data accordingly. We present and compare results of our methods and suggest some areas of future research.

## THE POTENTIAL BENEFIT OF WIND POWER PLANT GEOGRAPHIC DIVERSITY

Wind can be described as a stochastic process. As such, the power output from a wind power plant can vary substantially through time, and it is not controllable in the same way as that of conventional power plants. During lulls in the wind, electricity must be supplied by other resources. If geographically diverse wind sites can be chosen in such a way as to minimize the number or extent of wind power lulls, this can be beneficial because conventional-resource use can be reduced accordingly, and results in less conventional capacity expansion over time. The extent of this reduction will influence the magnitude of fuel cost, operations and maintenance (O&M), and other costs to the utility. Of course the increase in wind power generation is not without additional costs, such as O&M.

One of the first comprehensive studies to address the issue of geographical diversity of wind plants was done by Kahn (1979), who used California wind and utility data. He found that reliability does increase as a function of geographic dispersal, but this increase is limited by the geographic wind diversity and the barrier of large wind plant penetrations relative to the conventional generator mix. Kahn also points out that wind sites that are uncorrelated will generally provide better combined reliability than sites that are highly correlated, in absolute value. However, Kahn’s analysis ignores the fact that two or more wind regimes with significantly different time-scale properties can both provide a similar correlation with utility load (see Milligan and Artig, 1998b). A study by Brower (1993) found some benefits to distributed wind development in Minnesota, but the benefits were somewhat constrained by the relatively high wind-speed correlation between wind sites.

## STATE OF MINNESOTA DATA COLLECTION PROJECT

The wind resource data used in this study were collected through the Minnesota Department of Public Service's (DPS) wind resource-assessment programs and the DPS/U.S. Department of Energy (DOE) Tall Tower Wind Shear Study.

The monitoring sites that provided data for this paper are equipped with cellular data loggers that automatically send the collected information to a base-station computer located in DPS offices. These sites use existing communication towers and have wind-speed monitoring levels at 30, 50, and 70 meters above ground level, and some sites have wind vanes at 30 and 70 meters. Two anemometers are mounted at each level, one on each side of the tower. This configuration has a number of advantages. It reduces the wind-shadow effect the tower would have on the data if only one anemometer were used at each level; it provides a degree of redundancy at each level so that the failure of one sensor does not eliminate the data collection at that level; and it provides the opportunity to do sensor-to-sensor calibration and helps diagnose potential problems with sensors. Each tower is also equipped with wind vanes at the 30 and 70 meter levels.

### WIND SITE SELECTION

We chose six wind sites that, in our judgement, did the best job of representing the diversity of climatology in the state. The sites we selected are Alberta, Becker City, Brewster, Crookston, Currie, and Luverne. They appear in Figure 1, and are identified by the first two letters of the respective site name. One of the unique features of the Minnesota DPS data-collection effort is that wind data are collected to a height of 70 meters. This made it possible for us to use the power curve of a modern utility-scale turbine at a hub height of 65 meters. A comparison of output at different hub heights appears in Table 1, which shows the capacity factor at each site. We used wind data for one year, beginning November 1995.

For many utilities, simply maximizing wind energy capture during the system peak will not necessarily result in maximum benefit. The reason is that generating units' ramp rates and minimum-run levels may not allow for full utilization of the wind power if there is significant variation in the timing of wind power delivery to the grid. In addition, it is possible that the ability to accurately forecast hourly wind speeds and the consequent hourly wind power output is somewhat impaired by wind sites with high hourly variability. For a more thorough discussion of the relationship between wind forecasting and wind capacity credit, see Milligan, Miller, and Chapman (1995). For these reasons, it may be to the utility's

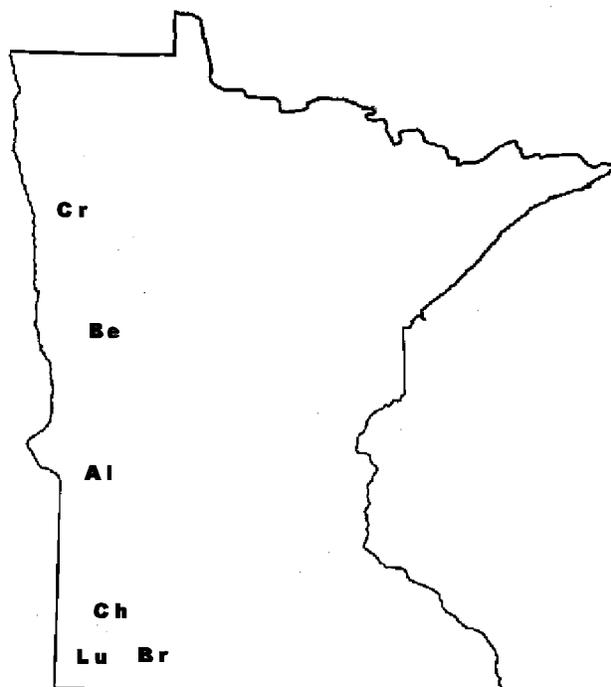


FIGURE 1. WIND SITES CHOSEN FOR THIS STUDY


advantage to install wind plants and select among sites in such a way that hour-to-hour output variations between wind plants are reduced, while still obtaining as much wind power output as possible during the peak period.

Figures 2 and 3 illustrate some potential benefit from different sites. The graphs are based on real wind data which were used to calculate output of fictitious

wind power plants, each with 100 MW of installed capacity. The hourly wind power is calculated by taking actual wind-speed data and calculating power output based on a utility-scale wind turbine, as described more fully below. Figure 2 shows a 48-hour period for three of the sites used in this study: Alberta, Currie, and Luverne. During the first day, the highest output comes from the Currie site, and Alberta and Luverne show low power output. The second day, wind power output at Currie is low, whereas power output at both Alberta and Luverne reach maximum rated output (less losses). Power output


TABLE 1. WIND POWER CORRELATION WITH LOAD AND CAPACITY FACTOR AT DIFFERENT TURBINE HUB-HEIGHTS

	Correlation to Load	50m	60m	65m
Alberta	-0.0135	.287	.320	.332
Becker	-0.0436	.287	.311	.322
Brewster	-0.0395	.333	.362	.374
Crookston	-0.0035	.270	.297	.309
Currie	-0.0539	.362	.388	.402
Luverne	-0.0317	.320	.343	.358

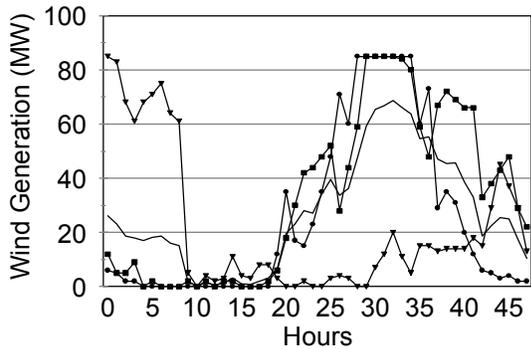

—■— Alberta —▲— Currie —◆— Luverne — Mean

FIGURE 2. WIND POWER OUTPUT OVER A 2-DAY PERIOD FROM MULTIPLE SITES

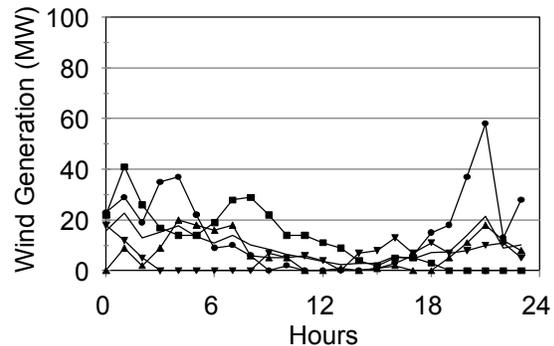

—■— Alberta —▲— Brewster —◆— Currie —●— Luverne — Mean

FIGURE 3. WIND POWER OUTPUT OVER A 1-DAY PERIOD FROM MULTIPLE SITES

at Luverne drops about 4-5 hours earlier than at Alberta late in the second day. Figure 3 shows another view of multiple-site wind power output. This 24-hour period shows a general correlation between sites, yet one can also detect time lags of 2-3 hours early and late in the day. These variations are somewhat typical of the data used in this study and illustrate the potential benefit of geographically diverse wind power plants.

## MODELING

Electrical reliability is a function of customer demand and the characteristics of the various generators. Utilities experience a pronounced peak period, often during several hours of the day during a particular season. A utility can sometimes dramatically increase its generator reliability by installing peaking units to generate power when it is most needed: during the peak hours. Even though these peaking units might be available at night, their availability at night would likely have a negligible effect on system reliability. Likewise, a wind plant that delivers a significantly higher annual energy output does not necessarily significantly contribute to system reliability. What is needed is for the wind output to occur at times of otherwise high-risk periods during system peak.

Kahn's (1979) discussion centers around the statistical correlation between the various wind-plant sites. Sites with high positive correlation will provide higher output during the same time periods, whereas sites with high negative correlation will be complementary. When the first site is providing a high level of electrical output to the grid, the second site will likely be idle. Conversely, when the first site is not producing electricity, it is likely that the second site is. Milligan and Artig (1998b) borrow from the analysis in Milligan and Parsons (1997), applying several methods that do not require the use of a production cost or reliability model.

Reliability of the electrical system can be calculated by a production cost/reliability model. The model we used is a load-duration curve model, Elfin, and is produced by the Environmental Defense Fund. The model uses hourly electrical load data and generation data to calculate the optimal mix of generating resources required to serve the load. The hourly loads are arranged by subperiod and are sorted and arranged into a cumulative-probability distribution. Generating resources are then matched to the load based on merit order, which is usually least-cost dispatch. Because each generator has a probability of failure, its dispatch is uncertain. The model takes this into account during the dispatch simulation, and various calculated indices can then summarize system reliability. The two most common reliability measures are loss-of-load expectation (LOLE) and expected energy not served (ENS). Figure 4 shows a normalized load-duration curve for the state of Minnesota. After all available generation has been dispatched, there may be a small spike at the top of the curve. The vertical distance from the curve to the 100% level of peak represents the LOLE, and the area of the spike representing the ENS. More details can be found in Milligan (1996a).

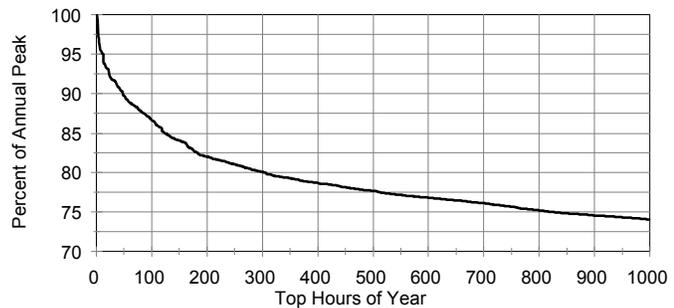


FIGURE 4. MINNESOTA ANNUAL LOAD-DURATION CURVE

The precise form of the optimal wind-plant reliability problem may vary according to the customer loads, wind sites, and characteristics of the utility system. For example, a combination of wind regimes that all exhibit diurnal variation may provide the utility an opportunity to select a combination of sites that together have a high probability of offsetting system peak requirements. Such a scenario might involve calculating various probability levels of wind generation during several peak hours every day of the peak month(s). Alternatively, when the wind resources do not follow a pronounced diurnal pattern, the utility might be more interested in looking at the overall probability levels of wind generation during the month, without necessarily allowing for a repetitive daily pattern in wind generation.

Choosing the best combination of wind sites can be done with a number of objective functions, depending on what the decision makers believe is most relevant. Among these are (1) least-cost combinations of wind sites, (2) wind sites that minimize load swings during system peak, or (3) most reliable wind sites. The goals of least-cost production and most-reliable production are usually not consistent with each other. Reliability must be traded off against cost because a perfectly reliable system (if one were to exist) would not be cost effective. Likewise, a least-cost solution might result in a generating system that does not possess sufficient reliability. For this analysis, we chose to pursue an optimization based on reliability. The results can be easily extended to capacity credit, electricity-production cost, or other parameters of interest.

### OPTIMIZATION WITH ELFIN

This approach uses the production-cost/reliability model in such a way as to do a step wise modification of the net remaining load after each incremental wind plant is built. This method could perhaps be best understood by referring to Figure 5. There are two possible variations of this approach. The first variation uses LOLE as the optimization parameter. The second variation uses ENS as the optimization parameter. The step in the diagram that illustrates the choice of site with the best reliability parameter instructs us to choose the wind site with the *lowest* parameter, either LOLE or ENS, because higher values of LOLE and ENS represent less reliable systems. The step entitled “build an X MW wind plant” implies that the incremental size of the plant to simulate building can be varied. In our case, we chose  $X = 25$  MW as a reasonable trade-off between accuracy and model run-time. Smaller values of X might be more accurate, although given the relative scale of X to the hourly loads, we do not think so. Large values of X compromise the results because the optimization algorithm is restricted to large increments of wind capacity, possibly overshooting a better mix of sites.

Following the outline of Figure 5, this is the optimization. This discussion focuses on the use of ENS as the reliability parameter, but the process is the same when we use LOLE as the optimization parameter. First, we run Elfin without any wind plants. The next step is to run Elfin for a block of 25 MW of installed wind capacity at each site, separately. We compare the ENS calculation at each site, and choose the site with the lowest ENS (best reliability). The process then simulates the building of 25 MW of wind capacity at the chosen site, and this becomes the new base case. We repeat the

*Do until desired wind capacity is built*  
*(1) calculate reliability parameter for X MW at each wind site*  
*(2) choose wind site with best reliability and “build” an X MW wind plant at this site*  
*(3) repeat*

process, running Elfin for each site combined with the chosen site from the previous step. Then we choose 25 MW from the site with the best ENS, and repeat until all 500 MW of wind has been installed. The algorithm then simply counts the number of 25-MW increments of wind plants added at each of the sites, and that is our result.

FIGURE 5. OPTIMIZATION ALGORITHM

We implemented this algorithm by developing an optimization shell that interacts directly with the Elfin model. The optimizer executes Elfin and compares the results from each of the six candidate sites. The best one is chosen, and Elfin is instructed to install a 25 MW block at this optimal location. This process is repeated for each 25-MW block of wind capacity.

The optimization using LOLE selects 100 MW at Alberta, 400 MW at Brewster, 275 MW at Currie, and 50 MW at Luverne. The ENS optimization selects 50 MW at Alberta, 700 MW at Brewster, 50 MW at Currie, and 25 MW at Luverne. However, these results do not tell the whole story. When we examined the selection part of the

optimization, we found that there were often extremely small differences in either LOLE or ENS between the chosen site and the second or third runner-up. This issue is discussed further in the next section.

### INTER-ANNUAL VARIATIONS AND UNCERTAINTY

The wind-speed data used for this study were collected by anemometers mounted on a single tower at each of the six sites we analyzed. Using a power curve for a modern wind turbine, we calculated hypothetical power output, after accounting for wake effects and mechanical and electrical losses. If 25-MW clusters of wind turbines were built on any of these sites, however, each turbine would respond to somewhat different winds, depending on the terrain and microscale meteorological events. We are therefore forced to accept the proposition that each time series of wind speeds represents one of many possible series. Although it is possible that each of these meteorological towers has been placed in a “representative” location for the overall site, we have no assurances that this is indeed the case. The implication of this is that the precise calculations from our models are based on somewhat imprecise data.

In previous work, we have also been somewhat skeptical of modeling that does not explicitly take interannual variations in wind speed into account (Milligan, 1996b). So far, this paper is also subject to that critique. Because of data constraints we were not able to perform a full analysis of the underlying time-series properties from multiple years of data at each wind site, although that would be our preferred approach. This would allow the use of sequential Monte Carlo runs with Elfin, resulting in probability distributions of the reliability measures of each wind plant and combination of plants (see Milligan and Graham, 1997). Such an analysis would allow for the explicit accounting of the underlying probability distributions, which would help the decision maker assess the impact of these variations.

In the absence of a more detailed analysis, we applied a technique borrowed from fuzzy logic (Miranda, 1996, and applications such as Monteiro and Miranda, 1997, and Pereira et al 1997) to this problem. The use of fuzzy logic allows our modeling to incorporate the uncertainty associated with the issues discussed above. The fuzzy set theoretic approach allows us to map our analysis in such a way as to recognize that small numerical differences that arise from various measurement errors and model approximations are meaningless. We hypothesized that the LOLE and ENS measures that we obtained from the Elfin optimization are fuzzy values, with variations ranging up to  $\pm 0.5\%$  of the calculated value. The choice of this range of values is based on the partial results of our optimization runs. As we examined the reliability values of the best site compared to the runners-up, there appeared to be a clustering of reliability values very close to the optimal values, whereas the least optimal plant’s reliability values were significantly worse. In our judgement, the choice of 0.5% is a reasonable one, based on our data. In the absence of specific probability distributions, we hypothesize that the reliability measures are distributed uniformly on this interval, which is similar to other approaches using fuzzy analysis. We then modified the selection-decision portion of the optimization algorithm to select not only the best single site, but any site whose optimization parameter is within some small distance of the best choice. Because we have no *a priori* knowledge of which fuzzy value is best, we performed an analysis using stepwise increments from 0.0% up to 0.5% of the differences in the reliability measure and averaged each of the fuzzy cases. This amounts to choosing a 25-MW block of installed wind capacity whenever

$$c_p(1-\epsilon) \leq c_i \leq c_p(1+\epsilon) \quad (1)$$

where  $c_p$  is the reliable capacity of the best site,  $\epsilon$  is the fuzzy parameter expressed as a decimal, and  $c_i$  represents the capacity of plant  $i$ ,  $1 \leq i, p \leq 6$ , and  $p \neq i$ . Although the algorithm uses an incremental wind plant size of 25

MW, the model repeats the process for different values of the fuzzy parameter,  $\epsilon$ . Each of these cases is averaged, so that the selected capacity at each wind site is not a multiple of 25. The fuzzy ENS method selects 108 MW at Alberta, 347 MW at Brewster, 197 MW at Currie, and 172 MW at Luverne. The fuzzy LOLE results are 139 MW at Alberta, 255 MW at Brewster, 249 MW at Currie, and 182 MW at Luverne.

Our preferred method is the fuzzy ENS approach because ENS represents the area under the load-probability distribution, whereas LOLE represents the height of the tail. Depending on relative costs of purchasing on-peak capacity and energy, a utility could use whichever method is most appropriate.

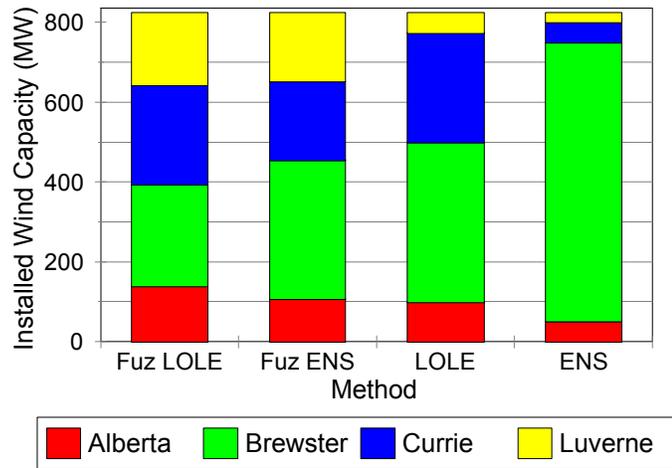


FIGURE 6. COMPARISON OF METHODS

### COMPARISON OF RESULTS

A summary of results appears in Figure 6. Each bar in the diagram represents a single method. The first two methods provide similar results, and the best combination of sites excludes Becker and Crookston. In each of these cases, the lowest recommended capacity is at Alberta. Brewster and Currie are both recommended in the range of 150 to about 325 MW, and Luverne's share ranges from about 175 to about 185 MW. The right side of the graph shows how unstable the results can be when we use a deterministic approach. A small amount of capacity at Luverne is chosen in both cases, but there is clearly a very large difference in the capacity recommendations for Brewster and Currie. The reason for this disparity is because of the extremely close values in reliability that were often found among the runners-up. In this case, Brewster and Currie were very close in both the LOLE- and ENS- reliability measures, so small differences between these measures altered the relative ranking of the sites. This is one reason for the application of a method that recognizes the role of uncertainty in the modeling. The method of choice, in our judgement, is the fuzzy ENS approach. We believe that ENS provides a more robust measure of reliability, in general, than does LOLE, and is more likely to be stable over short variations in load and generator parameters.

### OTHER METHODS AND RESULTS

In general, it is tempting to believe that the correlation between wind power output and utility load provides a way of ranking the relative merit of various wind sites. Milligan and Artig (1998b) offer a more complete discussion,

TABLE 2. REGRESSION RESULTS

Regression	Intercept	Capacity Factor		Correlation with Load		Installed Capacity		R <sup>2</sup>
		Coef	t	Coef	t	Coef	t	
1 ENS	1.108e+00	-1.20e+00	-12.3	-8.46e-01	-4.5	-4.68e-04	-45.8	0.92
2 LOLE	3.220e-04	-3.89e-04	-13.6	-2.60e-04	-5.5	-1.33e-07	-52.0	0.94

and show why this correlation does not by itself provide enough justification for choosing one site over another. We can also make the generalization that a wind site that provides more energy is likely to contribute more to system reliability than a site with less energy. To explore the validity of these ideas, given our data, we formulated two simple multiple regressions. We used wind-power correlation with utility load as the first exogenous variable, capacity factor as the second, and installed wind capacity as the third. These were regressed separately on the ENS reliability and LOLE measures. The data were obtained from a series of Elfin model runs, where each wind site was individually allowed to contribute up to 825 MW of wind capacity in 25-MW increments, for a total of 198 observations. Table 2 summarizes the result of the regressions. Although it is not apparent in the table, we found that the regression errors appeared to be related to the installed wind capacity variable. Our explanation for this is that the regression, in spite of somewhat impressive goodness of fit (high  $R^2$ ) and significant coefficients ( $|t| \geq 2.0$ ), the regression model is missing an explanatory variable. This is because this model is unable to take into account the complex chronological interactions between the electric load and wind power output. The relevance of this is that we *can* show the importance of capacity factor and correlation with load in determining reliability of wind power plants, but that these two measures alone are *not sufficient* in predicting the contribution to system reliability by a wind plant .

### FUTURE RESEARCH

Several other factors could be introduced into future studies. First, given additional intrasite data, the results would be more accurate. That could also lead to an analysis of the distributed benefits that could accrue on a smaller scale than analyzed here. Second, these results are sensitive to the specific load and generator characteristics used by the model. Additional data on wholesale power transactions from the state of Minnesota would improve the accuracy of these results. Finally, a complete analysis of multiple years of hourly wind data at the various sites would provide additional information about the trade-offs that could be expected between sites in future years. Constraints in the transmission system and power flow have not been considered here, but it would be important to analyze these factors before embarking on the installation of a large geographically diverse wind power system.

### CONCLUSIONS

Although production-cost models can be applied to the problem of selecting among competing sites for wind generators, the use of these models must be tempered with some judgement. There are a variety of factors that can influence wind power production across a site and through time. The wind sites that we have analyzed exhibit some overall correlation, but also provide some benefit to the overall system reliability because of time lags in hourly generation. All of the methods presented here find an optimum solution with wind capacity installed at multiple sites. We believe that the fuzzy ENS analysis provides the best means of analysis of such problems because it represents the area under the LDC. A utility could use either ENS or LOLE, however, depending on the relative purchase prices of on-peak capacity and energy. Geographic diversity of wind plants can play an important role in optimizing the benefits of such power plants. We have shown that the wind-power correlation to load and wind capacity factors are important factors for modeling wind plant reliability, but they alone are not sufficient to predict the contribution to system reliability by a wind plant. It is clear that geographically disperse wind resources provide a higher degree of reliability than a single-site development.

### ACKNOWLEDGMENTS

This paper was prepared as an account of work performed at NREL in support of DOE under contract number DE-AC36-83CH10093.

The authors would like to thank Brian Parsons of NREL, Ali Chowdhury of Alberta Power, Canada and Vladimiro Miranda of INESC, Portugal for helpful comments, and to acknowledge support from the FIRST/STEP program at NREL, and the Minnesota Department of Public Service.

## REFERENCES

Billinton, R., and H. Chen. "Determination of Load Carrying Capacity Benefits of Wind Energy Conversion Systems." *Proceedings of the Probabilistic Methods Applied to Power Systems 5<sup>th</sup> International Conference; September 21-25, 1997*; Vancouver, BC, Canada. Vancouver, BC, Canada: BC Hydro.

Brower, M. (1993). *Powering the Midwest: Renewable Electricity for the Economy and the Environment*. Union of Concerned Scientists. Cambridge, MA.

Kahn, E. (1979). "The Reliability of Distributed Wind Generators." *Electric Power Systems Research*. Vol 2. 1979. Elsevier Sequoia. Lausanne.

Milligan, M. (1996a). *Alternative Wind Power Modeling Methods Using Chronological and Load Duration Curve Production Cost Models*. NREL/TP-441-8171. Golden, Colorado: National Renewable Energy Laboratory.

Milligan, M. (1996b). "Variance Estimates of Wind Plant Capacity Credit." *Windpower '96 Proceedings; June 23-27, 1996*; Denver, Colorado. NREL/TP-440-21311. Golden, Colorado: National Renewable Energy Laboratory.

Milligan, M., and R. Artig (1998a). "Optimal Site-Selection and Sizing of Distributed Utility-Scale Wind Power Plants." *Proceedings of the 21<sup>st</sup> Annual International Conference of the International Association of Energy Economists*; Quebec City, Quebec, Canada. NREL/TP-xx-xxxxx. Golden, Colorado: National Renewable Energy Laboratory.

Milligan, M., and R. Artig (1998b). *Modeling Reliability Benefits of Distributed Wind Resource Development*. NREL/TP-500-24313. (To be published.) Golden, Colorado: National Renewable Energy Laboratory.

Milligan, M., A. Miller, and F. Chapman (1995). "Estimating the Economic Value of Wind Forecasting to Utilities." *Windpower '95 Proceedings; March 27-31, 1995*; Washington, DC: American Wind Energy Association.

Milligan, M. and M. Graham (1997). "An Enumerative Technique for Modeling Wind Power Variation in Production Costing." *Proceedings of the Probabilistic Methods Applied to Power Systems 5<sup>th</sup> International Conference; September 21-25, 1997*; Vancouver, BC, Canada. Vancouver, BC, Canada: BC Hydro.

Milligan, M. and B. Parsons (1997). "A Comparison and Case Study of Capacity Credit Algorithms for Intermittent Generators." Presented at Solar '97, Washington DC, April 27-30, 1997. NREL/CP-440-22591. Golden, Colorado: National Renewable Energy Laboratory.

Miranda, V. (1996). "Fuzzy Reliability Analysis of Power Systems." *PSCC Proceedings; August, 1996*; Dresden, Germany.

Monteiro, C., and V. Miranda (1997). “Probabilities and Fuzzy Sets in the Market Evaluation of Renewable Energies—The SolarGIS Experience.” *Proceedings of the Probabilistic Methods Applied to Power Systems 5<sup>th</sup> International Conference; September 21-25, 1997*; Vancouver, BC, Canada. Vancouver, BC, Canada: BC Hydro.

Pereira, J., J. Saraiva, and V. Miranda (1997). “Combining Fuzzy and Probabilistic Data in Power System State Estimation.” *Proceedings of the Probabilistic Methods Applied to Power Systems 5<sup>th</sup> International Conference; September 21-25, 1997*; Vancouver, BC, Canada. Vancouver, BC, Canada: BC Hydro.